



འབྲུག་གྲོག་མེ་ལས་འཛིན།

Bhutan Power Corporation Ltd.
Bhutan Power System Operator
Thimphu: Bhutan



Message No.: Enter your message number
From: Shift In-charge, Control Room

Date: 29-Oct-17
Time: 9:17

To
Managing Director, BPC. Email: gemtshering@bpc.bt
Director, O&MD, DGPC. Email: director.umd@drukgreen.com
General Manager, TD, BPC. Email: ktobgye@bpc.bt
General Manager, DCSD, BPC. Email: sandeeprai@bpc.bt
General Manager, BPSO, BPC. Email: ujjwaldahal@bpc.bt

Sub: Load Generation Balance Report of Yesterday (28-Oct-2017).

Hours (BST)	Forecast		Actual		Hours (BST)	Forecast		Actual	
	Generation	Load	Generation	Load		Generation	Load	Generation	Load
0:00	861.2	250	819.0	263.2	12:00	864.3	275.5	810.8	285.05
0:15	861.2	247.6	817.1	262.0	12:15	864.3	278.9	838.8	279.27
0:30	861.2	249.9	816.0	262.4	12:30	864.3	277.6	843.7	279.18
0:45	861.2	245.8	818.2	264.9	12:45	864.3	271.7	844.7	276.00
1:00	861.2	247.6	817.8	267.7	13:00	864.3	269.5	842.1	282.38
1:15	861.2	247.2	816.6	263.1	13:15	864.3	270.2	843.1	279.59
1:30	861.2	247.4	815.6	256.6	13:30	864.3	269.6	844.3	278.20
1:45	861.2	247.4	816.4	262.4	13:45	864.3	267.6	844.2	276.31
2:00	861.2	246.1	816.0	260.9	14:00	864.3	266.4	840.1	277.06
2:15	861.2	247.6	815.1	263.9	14:15	864.3	267.4	839.3	285.05
2:30	861.2	246.1	817.8	264.6	14:30	864.3	263.4	839.4	284.52
2:45	861.2	247.2	818.4	265.7	14:45	864.3	266.4	841.6	282.17
3:00	861.2	248.9	817.5	267.2	15:00	864.3	264.6	842.5	283.86
3:15	861.2	246.9	817.9	267.0	15:15	864.3	269.7	842.7	279.82
3:30	861.2	246.1	816.2	269.3	15:30	864.3	269.4	842.6	285.66
3:45	861.2	244	814.7	267.8	15:45	864.3	265.1	843.4	283.38
4:00	861.2	244.5	815.5	267.0	16:00	864.3	262.5	843.0	282.07
4:15	861.2	249.6	816.4	262.9	16:15	864.3	263.9	820.6	282.22
4:30	861.2	249	815.3	267.8	16:30	864.3	267.8	822.4	276.73
4:45	861.2	250.4	815.9	262.4	16:45	864.3	274.2	820.1	292.31
5:00	861.2	251.6	816.1	264.5	17:00	864.3	277.3	821.9	298.73
5:15	861.2	256	815.0	277.3	17:15	864.3	286.1	819.0	302.69
5:30	861.2	260.8	817.7	285.0	17:30	864.3	298.5	822.9	316.21
6:45	861.2	267.5	815.2	279.5	17:45	864.3	309.8	821.0	329.18
6:00	861.2	275.3	814.6	288.8	18:00	864.3	316.6	824.2	338.66
6:15	861.2	286.3	814.4	297.1	18:15	864.3	322.9	827.2	337.42
6:30	861.2	293.3	814.3	307.7	18:30	864.3	321.1	822.6	330.51
6:45	861.2	300.3	815.3	307.5	18:45	864.3	317.9	826.2	328.52
7:00	861.2	299.3	812.7	306.6	19:00	864.3	316.5	825.8	313.29
7:15	861.2	294.9	813.9	309.0	19:15	864.3	310.8	826.4	322.80
7:30	861.2	292.3	815.4	301.6	19:30	864.3	308.2	823.1	319.94
7:45	861.2	284.2	814.7	299.0	19:45	864.3	304.5	825.4	315.05
8:00	861.2	281	814.1	294.7	20:00	864.3	299.3	823.5	309.29
8:15	861.2	282.1	813.4	294.3	20:15	864.3	293.7	826.8	309.55
8:30	861.2	281.3	814.1	296.9	20:30	864.3	294.9	823.7	306.34
8:45	861.2	280.5	815.4	296.9	20:45	864.3	289.8	823.5	303.11
9:00	864.3	278.1	815.4	297.1	21:00	864.3	285.8	822.8	297.71
9:15	864.3	279.9	813.7	293.9	21:15	864.3	282.5	823.8	295.77
9:30	864.3	281.2	813.3	285.4	21:30	864.3	277.6	820.0	289.24
9:45	864.3	280.8	818.6	281.3	21:45	864.3	273.7	824.8	287.88
10:00	864.3	278.1	815.3	287.0	22:00	864.3	272.3	823.3	283.98
10:15	864.3	273	814.0	288.9	22:15	864.3	266	822.5	280.70
10:30	864.3	272.8	813.0	272.8	22:30	864.3	266.4	825.1	273.88
10:45	864.3	274.6	814.9	284.8	22:45	864.3	257.1	824.0	273.35
11:00	864.3	274	810.0	288.7	23:00	864.3	257.1	822.5	270.97
11:15	864.3	275.6	815.5	291.6	23:15	864.3	253.6	824.0	268.69
11:30	864.3	277.8	813.4	272.3	23:30	864.3	257.4	823.2	264.43
11:45	864.3	276.2	816.7	284.9	23:45	864.3	255.2	825.1	262.60

Yours faithfully
Karma Choden

Coincidental peak load of Day(Last year):	
271.13 MW	28-Oct-16
Maximum Load till date:	
344.02 MW	18-Mar-17



འབྲུག་རྒྱལ་ཁོ་ལས་འཛིན།


Bhutan Power Corporation Ltd.
 Bhutan Power System Operator
 Thimphu: Bhutan



Message No.: Enter your message number
 From: Shift In-charge, Control Room

Date: 29-Oct-17
 Time: 9:17

Forecast Generation & Load with Actual Generation & Load (28-Oct-2017).

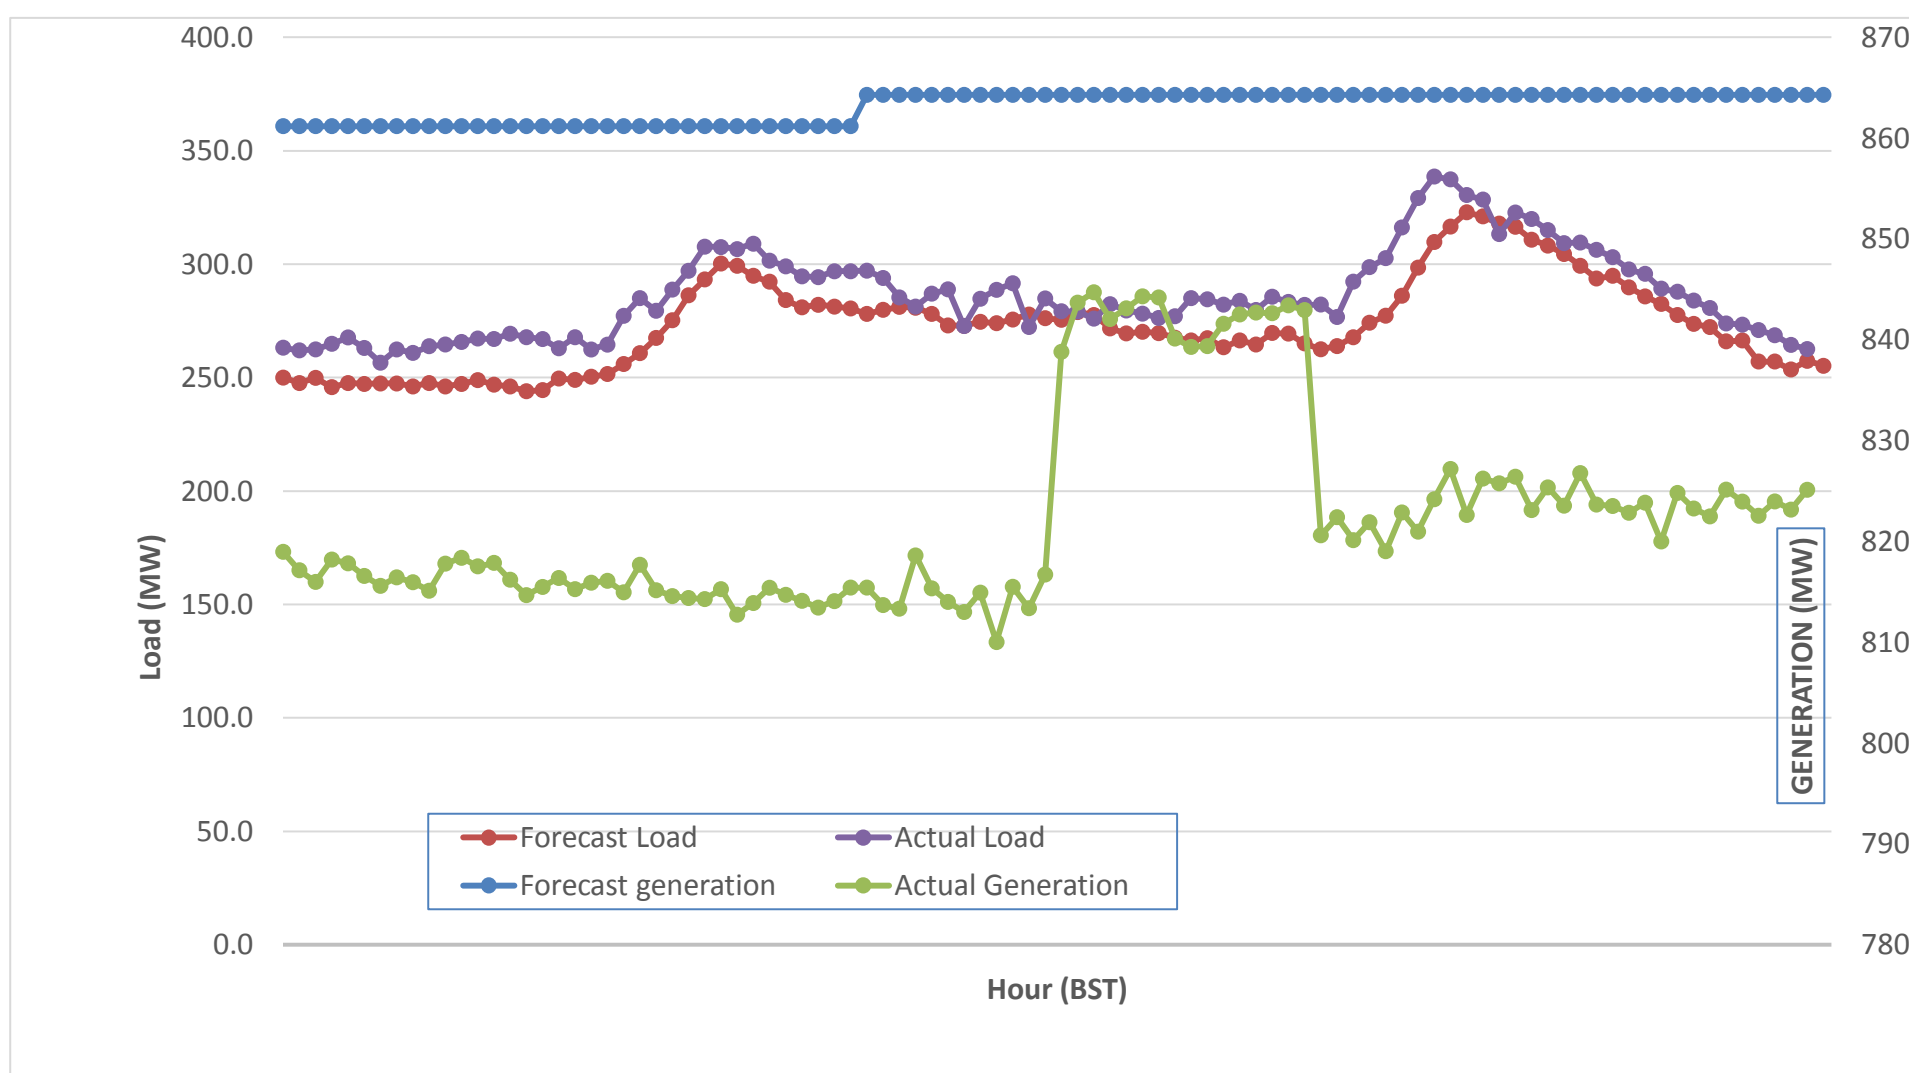

Yours faithfully,
 Karma Choden

	MW	Coincidental peak load of Day(Last year):	
Peak Co-incident Generation(28-Oct-2017).	844.72	271.13 MW	28-Oct-16
Peak Co-incident Load(28-Oct-2017).	338.66		
		Maximum Load till date:	
		344.02 MW	18-Mar-17

Telephone: +975-02335631; Fax: +975-02335632; Email: bhutansystemoperator@bpc.bt; www.bpc.bt



འབྲུག་གླིང་མི་ལས་འཛིན།

Bhutan Power Corporation Ltd.
Bhutan Power System Operator
Thimphu: Bhutan



Message No.: Enter your message number
From: Shift In-charge, Control Room

Date: 29-Oct-17
Time: 9:17

To
Managing Director, BPC. Email: gemtshering@bpc.bt
Director, O&MD, DGPC. Email: director.omid@drukgreen.com
General Manager, TD, BPC. Email: thinleygyeltshen@bpc.bt
General Manager, DCSD, BPC. Email: sandeprai@bpc.bt
General Manager, BPSO, BPC. Email: ujjwaldahal@bpc.bt

Sub: Load Generation Balance Report of Today (29-Oct-2017).

Hours (BST)	Forecast		Actual	
	Generation	Load	Generation	Load
0:00	808.8	256	825.0	263.64
0:15	808.8	253.6	825.4	264.15
0:30	808.8	255	824.7	261.91
0:45	808.8	251.9	825.5	262.65
1:00	808.8	253.4	824.6	263.52
1:15	808.8	252.9	823.2	252.66
1:30	808.8	253	824.2	260.30
1:45	808.8	252.8	821.9	260.78
2:00	808.8	251.1	830.6	263.37
2:15	808.8	251.5	822.0	260.15
2:30	808.8	248.1	823.1	258.24
2:45	808.8	249.3	821.7	243.22
3:00	808.8	250.2	821.6	252.02
3:15	808.8	248	823.3	257.21
3:30	808.8	247.2	803.0	253.60
3:45	808.8	246.5	803.2	251.19
4:00	808.8	245.6	801.9	238.47
4:15	808.8	250.3	802.7	257.94
4:30	808.8	251.5	801.0	260.86
4:45	808.8	253.2	802.6	261.03
5:00	808.8	254.7	804.7	260.30
5:15	808.8	259.2	802.5	263.27
5:30	808.8	261.2	802.4	268.08
5:45	808.8	266.8	804.8	268.13
6:00	808.8	276.3	803.7	278.44
6:15	808.8	287.5	803.6	274.70
6:30	808.8	295.5	802.0	286.16
6:45	808.8	301.1	800.4	292.55
7:00	808.8	301.5	805.7	292.52
7:15	808.8	295.5	800.9	294.27
7:30	808.8	292.9	803.1	291.88
7:45	808.8	286.2	799.8	285.89
8:00	808.8	282.6	802.3	281.51
8:15	808.8	284.1	802.2	285.09
8:30	808.8	282.3	801.6	281.97
8:45	808.8	282.7	799.9	274.03
9:00	808.8	280.3	802.2	282.98

Coincidental peak load of Day(Last year):	
283.51 MW	29-Oct-17

Maximum Load till date:	
344.02 MW	18-Mar-17


Yours faithfully,
Karma Choden



Message No.: Enter your message number
 From: Shift In-charge, Control Room

29-Oct-17
 9:17

Forecast Generation & Load with Actual Generation & Load of Today from 00:00hrs to 09:00hrs(29-Oct-2017).

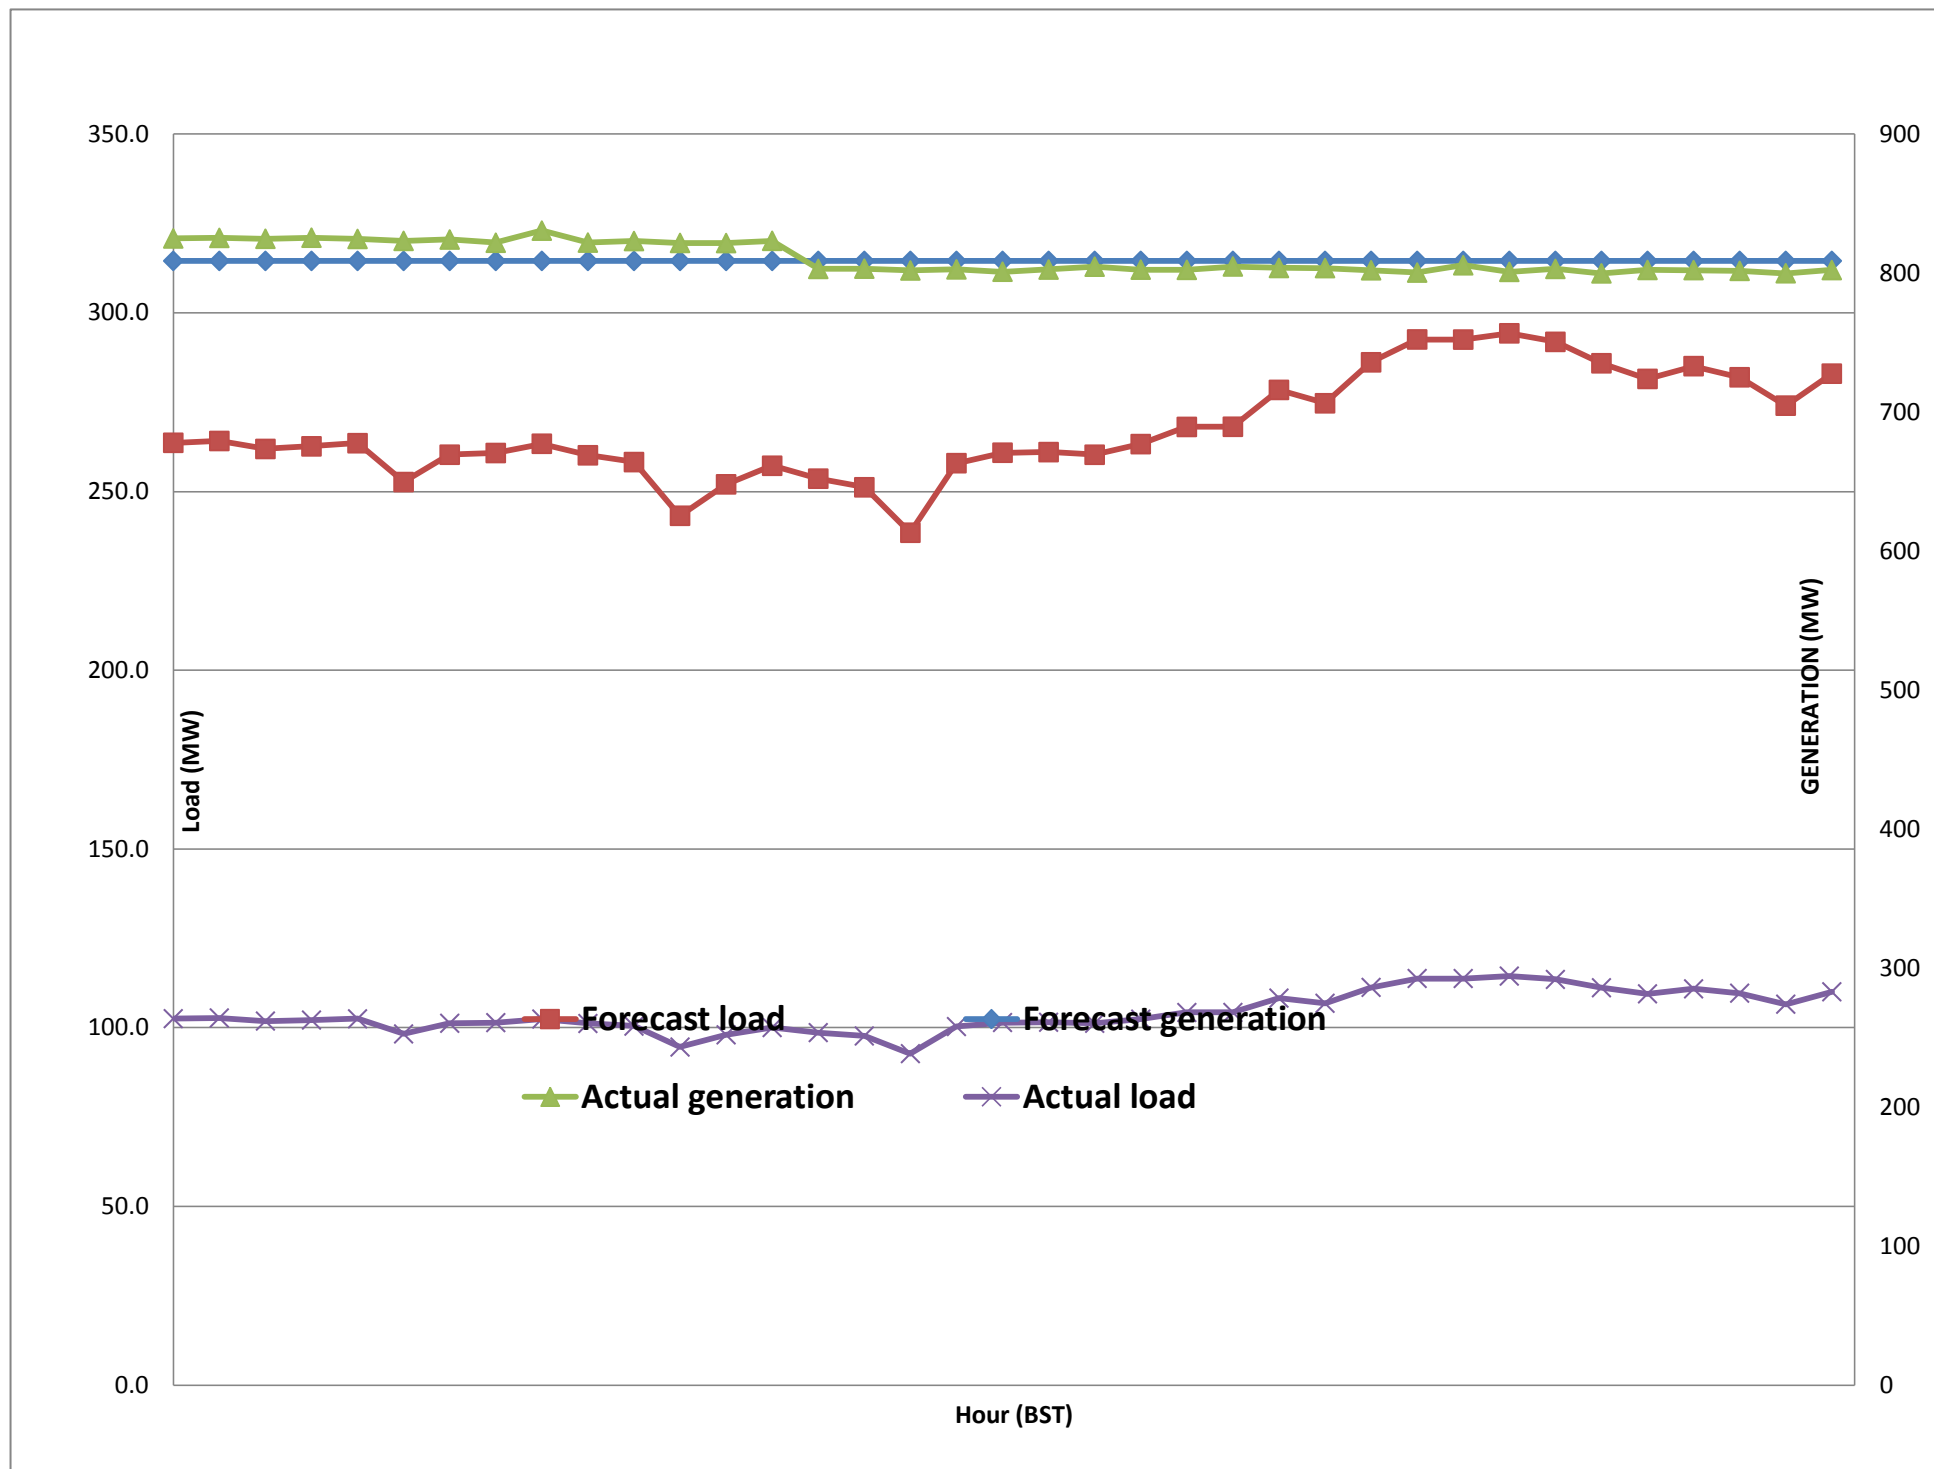

Yours faithfully
 Karma Choden



འབྲུག་གྲོག་ལས་ལེ་སྐོར་ལྷན་ཁག་།
Bhutan Power Corporation Ltd.
Bhutan Power System Operator
 Thimphu: Bhutan



Message No.: Enter your message number
From: Shift In-charge, Control Room
Date: 29-Oct-17
Time: 9:17

To

Managing Director, BPC. Email: gemtshering@bpc.bt
 Director, O&MD, DGPC. Email: director.umd@drukgreen.com
 General Manager, TD, BPC. Email: ktobgye@bpc.bt
 General Manager, BPSO, BPC. Email: ujjwaldahal@bpc.bt
 Advisor, BPC. Email: bharattamang@bpc.bt

Sub: Load Generation Balance Report of Tomorrow (30-Oct-2017).

Hours (BST)	Forecast		Hours (BST)	Forecast	
	Generation	Load		Generation	Load
0:00	796.4	258.80	12:00	796.4	276.1
0:15	796.4	256.90	12:15	796.4	277.1
0:30	796.4	256.90	12:30	796.4	279.6
0:45	796.4	255.70	12:45	796.4	275.6
1:00	796.4	257.80	13:00	796.4	273.4
1:15	796.4	256.00	13:15	796.4	275.1
1:30	796.4	256.10	13:30	796.4	273
1:45	796.4	256.70	13:45	796.4	269.5
2:00	796.4	254.90	14:00	796.4	273.6
2:15	796.4	255.30	14:15	796.4	274.7
2:30	796.4	250.20	14:30	796.4	273
2:45	796.4	253.40	14:45	796.4	273.9
3:00	796.4	255.80	15:00	796.4	273.1
3:15	796.4	253.20	15:15	796.4	275.9
3:30	796.4	252.90	15:30	796.4	278.6
3:45	796.4	252.40	15:45	796.4	273
4:00	796.4	251.60	16:00	796.4	272.8
4:15	796.4	255.00	16:15	796.4	275.2
4:30	796.4	254.30	16:30	796.4	277.6
4:45	796.4	256.50	16:45	796.4	285.2
5:00	796.4	257.50	17:00	796.4	288.5
5:15	796.4	264.20	17:15	796.4	295.6
5:30	796.4	266.90	17:30	796.4	309.7
6:45	796.4	271.10	17:45	796.4	322.4
6:00	796.4	281.10	18:00	796.4	329.3
6:15	796.4	291.90	18:15	796.4	333.2
6:30	796.4	300.70	18:30	796.4	330.1
6:45	796.4	304.80	18:45	796.4	327.3
7:00	796.4	305.10	19:00	796.4	322.8
7:15	796.4	299.40	19:15	796.4	320.4
7:30	796.4	296.70	19:30	796.4	316.9
7:45	796.4	290.60	19:45	796.4	313.5
8:00	796.4	285.90	20:00	796.4	307.5
8:15	796.4	287.00	20:15	796.4	303.6
8:30	796.4	286.90	20:30	796.4	304.1
8:45	796.4	286.30	20:45	796.4	297.5
9:00	796.4	284.70	21:00	796.4	294.2
9:15	796.4	286.50	21:15	796.4	290.5
9:30	796.4	283.90	21:30	796.4	285.5
9:45	796.4	283.30	21:45	796.4	280.9
10:00	796.4	284.00	22:00	796.4	278.7
10:15	796.4	279.40	22:15	796.4	274.2
10:30	796.4	275.90	22:30	796.4	270.6
10:45	796.4	281.70	22:45	796.4	265.4
11:00	796.4	280.90	23:00	796.4	263.6
11:15	796.4	280.60	23:15	796.4	261.2
11:30	796.4	281.40	23:30	796.4	262.3
11:45	796.4	278.70	23:45	796.4	260.4


Yours faithfully,
 Karma Choden



Message No.: Enter your message number
 From: Shift In-charge, Control Room

Date: 29-Oct-17
 Time: 9:17

Scheduled Generation & Load Forecast for Tomorrow (30-Oct-2017).

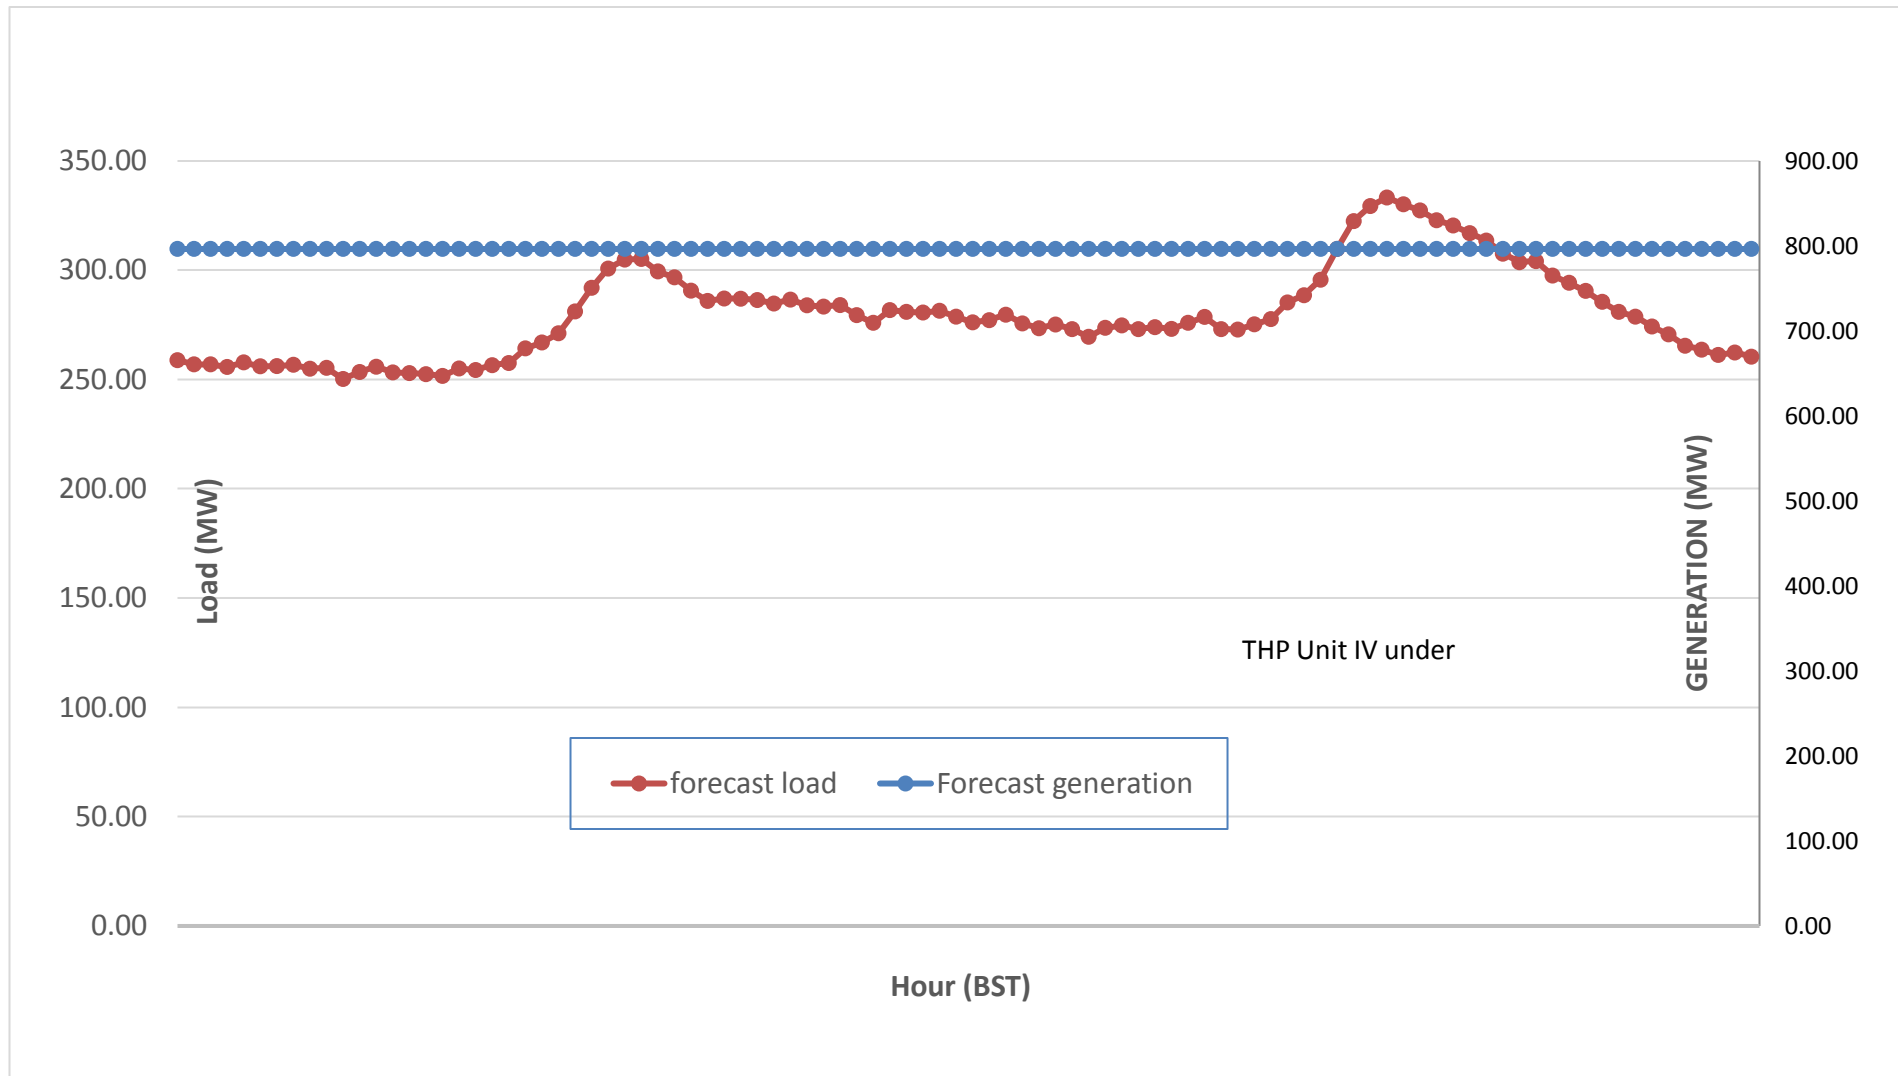

Yours faithfully,
 Karma Choden

	MW
Scheduled Peak Generation(30-Oct-2017).	376.90
Forecast Peak Load(30-Oct-2017).	300.60