



འབྲུག་གླིང་གི་ལམ་འཛིན།

Bhutan Power Corporation Ltd.
Bhutan Power System Operator
Thimphu: Bhutan



Message No.: Enter your message number
From: Shift In-charge, Control Room

Date: 17-Nov-17
Time: 10:55

To
Managing Director, BPC. Email: gemtshering@bpc.bt
Director, O&MD, DGPC. Email: director.umd@drukgreen.com
General Manager, TD, BPC. Email: ktobgye@bpc.bt
General Manager, DCSD, BPC. Email: sandeeprai@bpc.bt
General Manager, BPSO, BPC. Email: ujjwaldahal@bpc.bt

Sub: **Load Generation Balance Report of Yesterday (16-Nov-2017).**

Hours (BST)	Forecast		Actual		Hours (BST)	Forecast		Actual	
	Generation	Load	Generation	Load		Generation	Load	Generation	Load
0:00	588	284.4	565.5	241.3	12:00	588	299.1	599.5	280.14
0:15	588	287	563.9	242.8	12:15	588	294	593.7	278.70
0:30	588	302.1	581.7	230.2	12:30	588	291.6	595.4	281.55
0:45	588	297.2	590.9	236.6	12:45	588	285.2	596.7	275.33
1:00	588	308.7	597.9	225.1	13:00	588	285	593.4	280.97
1:15	588	304.5	566.6	242.7	13:15	588	280	595.1	281.50
1:30	588	299.8	566.1	244.5	13:30	588	275	594.8	274.45
1:45	588	295.3	567.7	251.3	13:45	588	274.3	595.8	274.19
2:00	588	295	566.8	252.5	14:00	588	276.6	592.2	275.11
2:15	588	279	564.2	247.1	14:15	588	278	595.6	279.37
2:30	588	255.5	564.2	238.0	14:30	588	277.9	594.1	280.09
2:45	588	241.1	563.0	239.3	14:45	588	273.8	594.9	278.78
3:00	588	230.7	563.3	237.2	15:00	588	276.2	594.8	272.73
3:15	588	220.5	564.4	232.3	15:15	588	276.3	592.6	273.15
3:30	588	206.1	568.1	249.8	15:30	588	278.2	594.4	276.91
3:45	588	205.4	565.8	231.9	15:45	588	278.5	589.0	273.62
4:00	588	212.5	566.8	246.1	16:00	588	285.5	588.4	272.27
4:15	588	219.1	565.2	238.4	16:15	588	288.3	583.8	280.17
4:30	588	238.8	567.5	247.4	16:30	588	298.7	567.9	281.15
4:45	588	243.2	564.8	244.1	16:45	588	298.1	574.5	279.04
5:00	588	261.1	563.5	244.1	17:00	588	309.7	576.4	296.09
5:15	588	276.1	586.6	253.4	17:15	588	320.2	574.8	318.91
5:30	588	278	586.8	259.9	17:30	588	333	575.5	330.36
6:45	588	284.5	586.2	270.5	17:45	588	345	577.1	337.18
6:00	600	293.5	583.8	280.3	18:00	600	350.4	578.4	345.06
6:15	600	309	586.7	295.1	18:15	600	353.4	577.4	345.20
6:30	600	327	595.0	305.3	18:30	600	349.7	586.1	346.88
6:45	600	331.1	595.5	321.7	18:45	600	350.4	588.1	342.78
7:00	600	331.1	594.9	329.4	19:00	600	345.6	586.6	342.52
7:15	600	321	597.4	327.4	19:15	600	344.9	583.3	341.70
7:30	600	314.9	597.1	321.5	19:30	600	341.6	586.5	339.18
7:45	600	304.2	594.3	314.3	19:45	600	335.6	584.5	336.38
8:00	600	276.6	595.9	308.7	20:00	600	335.4	586.8	331.80
8:15	600	253.6	595.9	300.9	20:15	600	333	566.5	333.15
8:30	600	338.3	595.9	295.9	20:30	600	330.8	565.2	330.77
8:45	600	303	594.5	284.3	20:45	600	318.5	565.3	326.11
9:00	600	302.9	594.4	290.8	21:00	600	310.8	565.6	315.42
9:15	588	302.9	605.7	296.8	21:15	588	308.5	557.4	314.16
9:30	588	297.1	605.8	289.5	21:30	588	302	553.6	304.73
9:45	588	298.1	604.6	287.1	21:45	588	303.5	556.3	294.12
10:00	588	293.8	604.4	285.3	22:00	588	298.9	552.8	298.38
10:15	588	292.2	603.3	285.5	22:15	588	293.4	549.2	295.38
10:30	588	288.7	602.8	285.2	22:30	588	286.5	566.1	287.87
10:45	588	291.6	599.4	279.3	22:45	588	285.4	565.0	283.45
11:00	588	291.9	601.0	274.0	23:00	588	280.8	563.8	276.84
11:15	588	297	600.8	261.9	23:15	588	279.9	566.3	274.48
11:30	588	296.2	607.4	279.9	23:30	588	284.2	566.0	268.06
11:45	588	298	600.0	280.8	23:45	588	278.6	563.9	259.55

Yours faithfully
Manoj Uraon

Coincidental peak load of Day(Last year):	
296.89	16-Nov-16
Maximum Load till date:	
362.09	14-Nov-17



འབྲུག་རྒྱལ་ཁོ་ལས་འཛིན།


Bhutan Power Corporation Ltd.
 Bhutan Power System Operator
 Thimphu: Bhutan



Message No.: Enter your message number
 From: Shift In-charge, Control Room

Date: 17-Nov-17
 Time: 10:55

Forecast Generation & Load with Actual Generation & Load (16-Nov-2017).

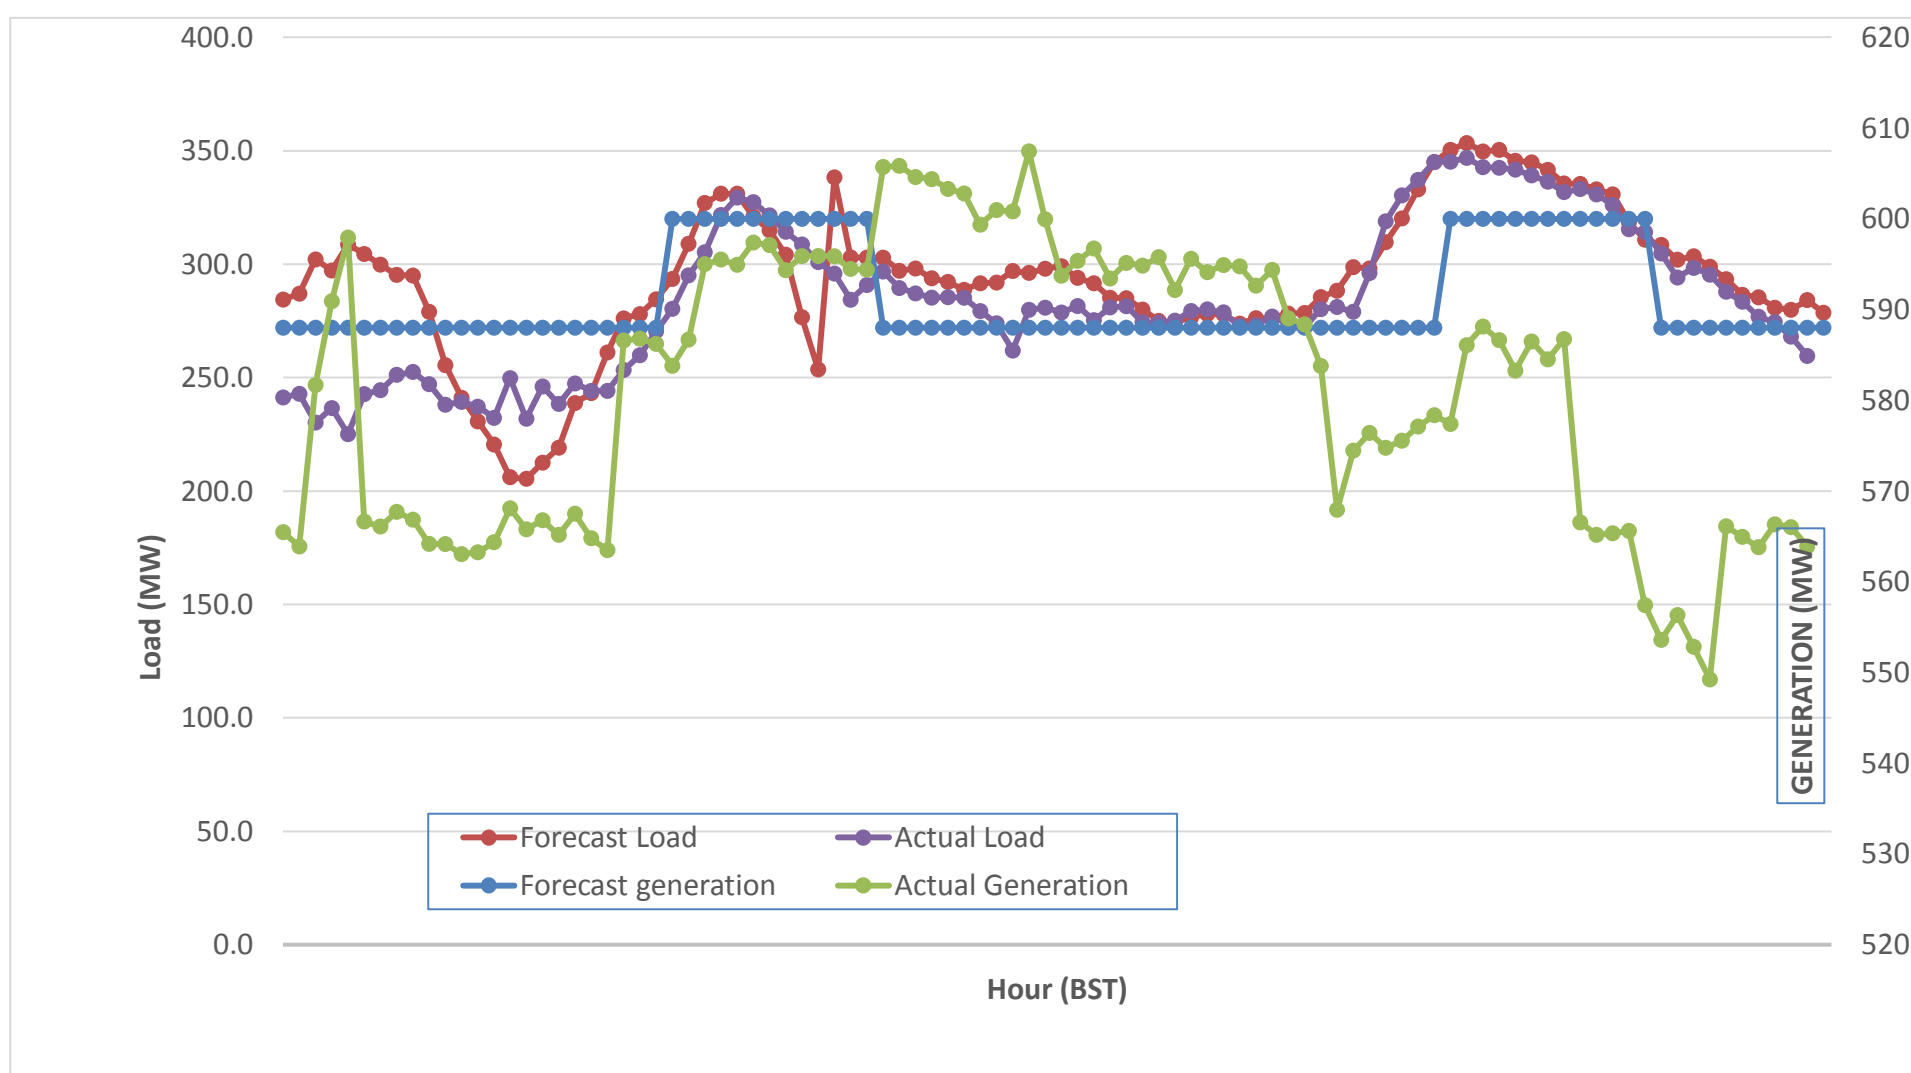

Yours faithfully,
 Manoj Uraon

	MW	Coincidental peak load of Day(Last year):	
Peak Co-incident Generation(16-Nov-2017).	607.44	296.89	16-Nov-16
Peak Co-incident Load(16-Nov-2017).	346.88		
		Maximum Load till date:	
		362.09	14-Nov-17

Telephone: +975-02335631; Fax: +975-02335632; Email: bhutansystemoperator@bpc.bt; www.bpc.bt



Bhutan Power Corporation Ltd.
Bhutan Power System Operator
Thimphu: Bhutan

ལྷན་ རྒྱལ་གྱི་ལོ་ལས་འཛིན།



Message No.: Enter your message number
From: Shift In-charge, Control Room

Date: 17-Nov-17
Time: 10:55

To
 Managing Director, BPC. Email: gemtshering@bpc.bt
 Director, O&MD, DGPC. Email: director.omid@drukgreen.com
 General Manager, TD, BPC. Email: thinleygyeltshen@bpc.bt
 General Manager, DCSD, BPC. Email: sandeprai@bpc.bt
 General Manager, BPSO, BPC. Email: ujjwaldahal@bpc.bt

Sub: Load Generation Balance Report of Today (17-Nov-2017).

Hours (BST)	Forecast		Actual	
	Generation	Load	Generation	Load
0:00	574.7	278.7	561.6	252.30
0:15	574.7	282.6	565.6	256.50
0:30	574.7	293.7	565.4	257.20
0:45	574.7	295.4	563.4	260.63
1:00	574.7	306.8	565.0	254.87
1:15	574.7	301.4	565.5	254.33
1:30	574.7	298.8	566.0	249.31
1:45	574.7	289.2	565.7	242.61
2:00	574.7	283.8	564.9	249.17
2:15	574.7	265.7	566.0	247.36
2:30	574.7	245.1	567.9	247.38
2:45	574.7	236	567.7	242.24
3:00	574.7	226.4	566.2	246.71
3:15	574.7	219.6	584.3	247.21
3:30	574.7	211.7	581.4	246.93
3:45	574.7	213.6	582.8	248.61
4:00	574.7	219.8	582.9	244.98
4:15	574.7	228.3	585.5	246.22
4:30	574.7	246.7	585.0	239.23
4:45	574.7	249.3	587.6	250.56
5:00	574.7	266.7	582.3	248.44
5:15	574.7	275.3	587.3	258.56
5:30	574.7	277.4	583.2	267.98
5:45	574.7	283.8	586.9	272.26
6:00	585.7	291.4	587.0	267.69
6:15	585.7	308	583.9	291.27
6:30	585.7	323.4	585.0	294.65
6:45	585.7	328.2	584.6	312.63
7:00	585.7	330.1	585.3	320.78
7:15	585.7	321.3	586.8	318.86
7:30	585.7	315.6	586.4	312.73
7:45	585.7	307.4	590.6	314.01
8:00	585.7	283.7	594.0	308.66
8:15	585.7	261.9	592.7	309.68
8:30	585.7	332.1	594.0	306.65
8:45	585.7	304	592.8	304.59
9:00	585.7	302.1	593.9	302.39

Coincidental peak load of	
296.89	16-Nov-16

Yours faithfully,
 Manoj Uraon

362.09	14-Nov-17
--------	-----------


Telephone:



Message No.: Enter your message number
 From: Shift In-charge, Control Room

11/10/2017 10:59 17-Nov-17
 11/10/2017 10:59 10:55

Forecast Generation & Load with Actual Generation & Load of Today from 00:00hrs to 09:00hrs(17-Nov-2017).

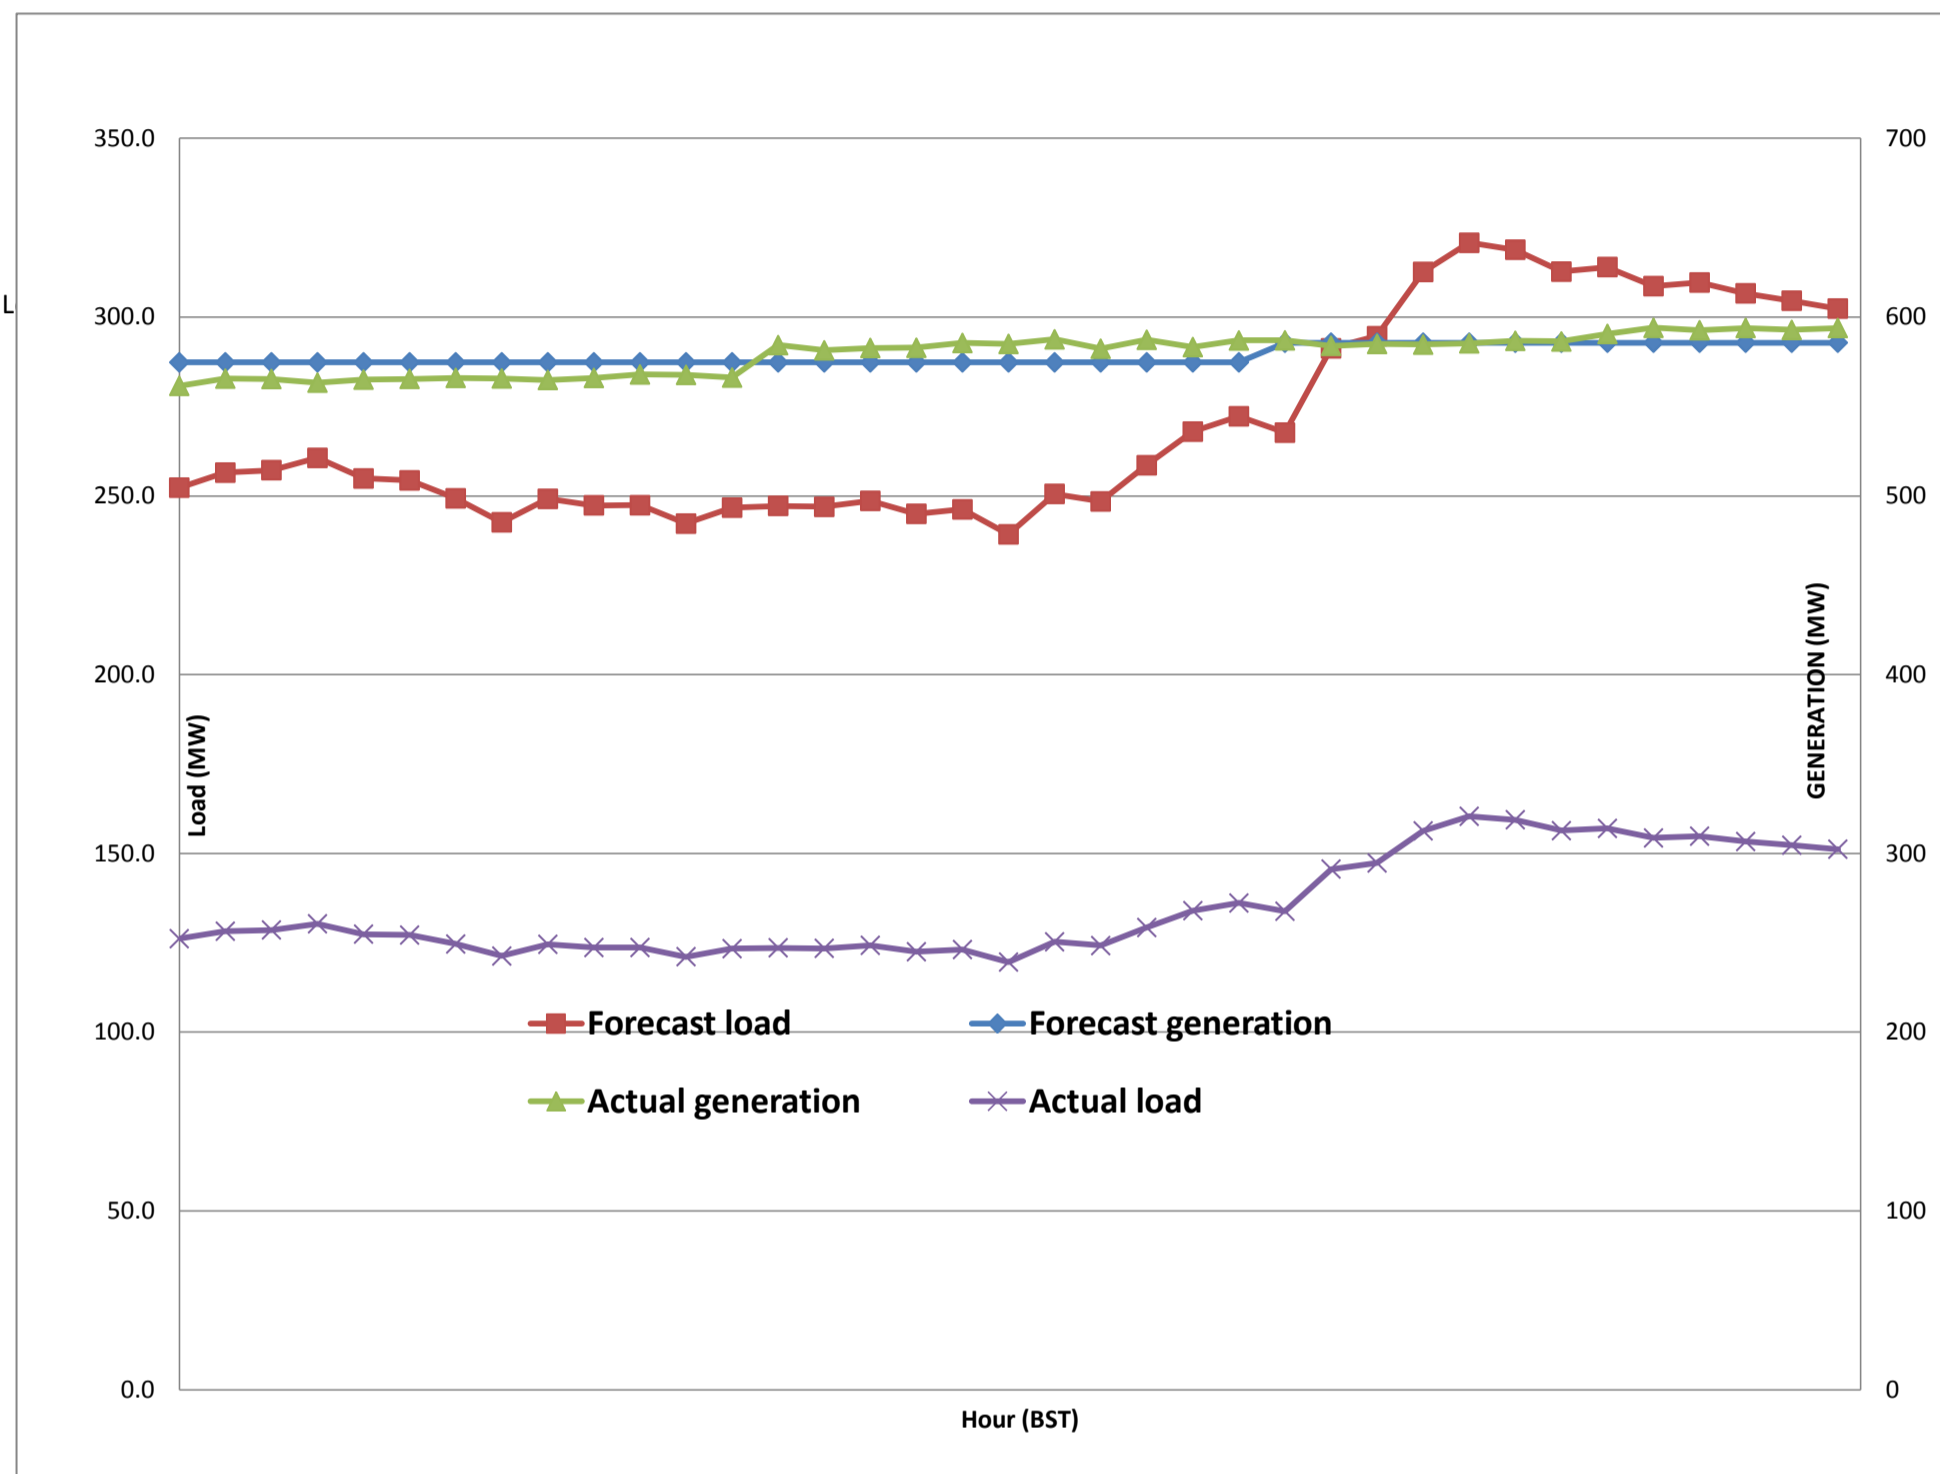

Yours faithfully
 Manoj Uraon



འབྲུག་གྲོགས་ཚེས་ལས་འཛིན།
Bhutan Power Corporation Ltd.
Bhutan Power System Operator
 Thimphu: Bhutan



Message No.: Enter your message number
From: Shift In-charge, Control Room
Date: 17-Nov-17
Time: 10:55


To

Managing Director, BPC. Email: gemtshering@bpc.bt
 Director, O&MD, DGPC. Email: director.umd@drukgreen.com
 General Manager, TD, BPC. Email: ktobgye@bpc.bt
 General Manager, BPSO, BPC. Email: ujjwaldahal@bpc.bt
 Advisor, BPC. Email: bharattamang@bpc.bt

Sub: Load Generation Balance Report of Tomorrow (18-Nov-2017).

Hours (BST)	Forecast		Hours (BST)	Forecast	
	Generation	Load		Generation	Load
0:00	596.90	267.20	4:48	596.9	296.1
0:15	596.90	271.40	2:24	596.9	293.4
0:30	596.90	275.70	0:00	596.9	291
0:45	596.90	280.60	7:12	596.9	286.3
1:00	596.90	290.40	16:48	596.9	286.2
1:15	596.90	289.60	0:00	596.9	277.3
1:30	596.90	285.80	2:24	596.9	273.7
1:45	596.90	282.70	4:48	596.9	275.4
2:00	596.90	283.40	4:48	596.9	276.5
2:15	596.90	264.90	19:12	596.9	277.8
2:30	596.90	240.90	21:36	596.9	277.8
2:45	596.90	235.20	4:48	596.9	275.5
3:00	596.90	228.70	16:48	596.9	277.6
3:15	596.90	223.50	2:24	596.9	278.6
3:30	596.90	220.60	14:24	596.9	279.1
3:45	596.90	216.50	9:36	596.9	280.2
4:00	596.90	226.20	7:12	596.9	281.5
4:15	596.90	227.90	19:12	596.9	285.7
4:30	596.90	244.90	12:00	596.9	291.8
4:45	596.90	248.80	16:48	596.9	293.8
5:00	596.90	263.30	7:12	596.9	305.5
5:15	596.90	272.40	9:36	596.9	318.7
5:30	596.90	275.60	4:48	596.9	332.1
6:45	596.90	281.60	9:36	596.9	341.8
6:00	605.50	289.60	4:48	605.5	350.3
6:15	605.50	304.80	21:36	605.5	350.9
6:30	605.50	320.60	14:24	605.5	347.8
6:45	605.50	327.00	7:12	605.5	343.9
7:00	605.50	329.40	21:36	605.5	339.3
7:15	605.50	329.00	7:12	605.5	339.3
7:30	605.50	318.70	19:12	605.5	335.9
7:45	605.50	282.70	21:36	605.5	328.1
8:00	605.50	263.20	16:48	605.5	329
8:15	605.50	263.40	21:36	605.5	326.8
8:30	605.50	322.90	0:00	605.5	324.4
8:45	605.50	300.70	9:36	605.5	315.3
9:00	605.50	301.70	19:12	605.5	306.4
9:15	596.90	302.90	2:24	605.5	305.7
9:30	596.90	298.70	12:00	605.5	297.5
9:45	596.90	297.40	16:48	605.5	292.8
10:00	596.90	293.90	16:48	605.5	291.6
10:15	596.90	292.90	0:00	596.9	286
10:30	596.90	291.90	7:12	596.9	278.7
10:45	596.90	290.90	2:24	596.9	273.9
11:00	596.90	289.70	16:48	596.9	270
11:15	596.90	288.40	9:36	596.9	267.8
11:30	596.90	293.20	14:24	596.9	265.8
11:45	596.90	295.20	4:48	596.9	264.2


Yours faithfully,
 Manoj Uraon



Message No.: Enter your message number
 From: Shift In-charge, Control Room

Date: 17-Nov-17
 Time: 10:55

Scheduled Generation & Load Forecast for Tomorrow (18-Nov-2017).

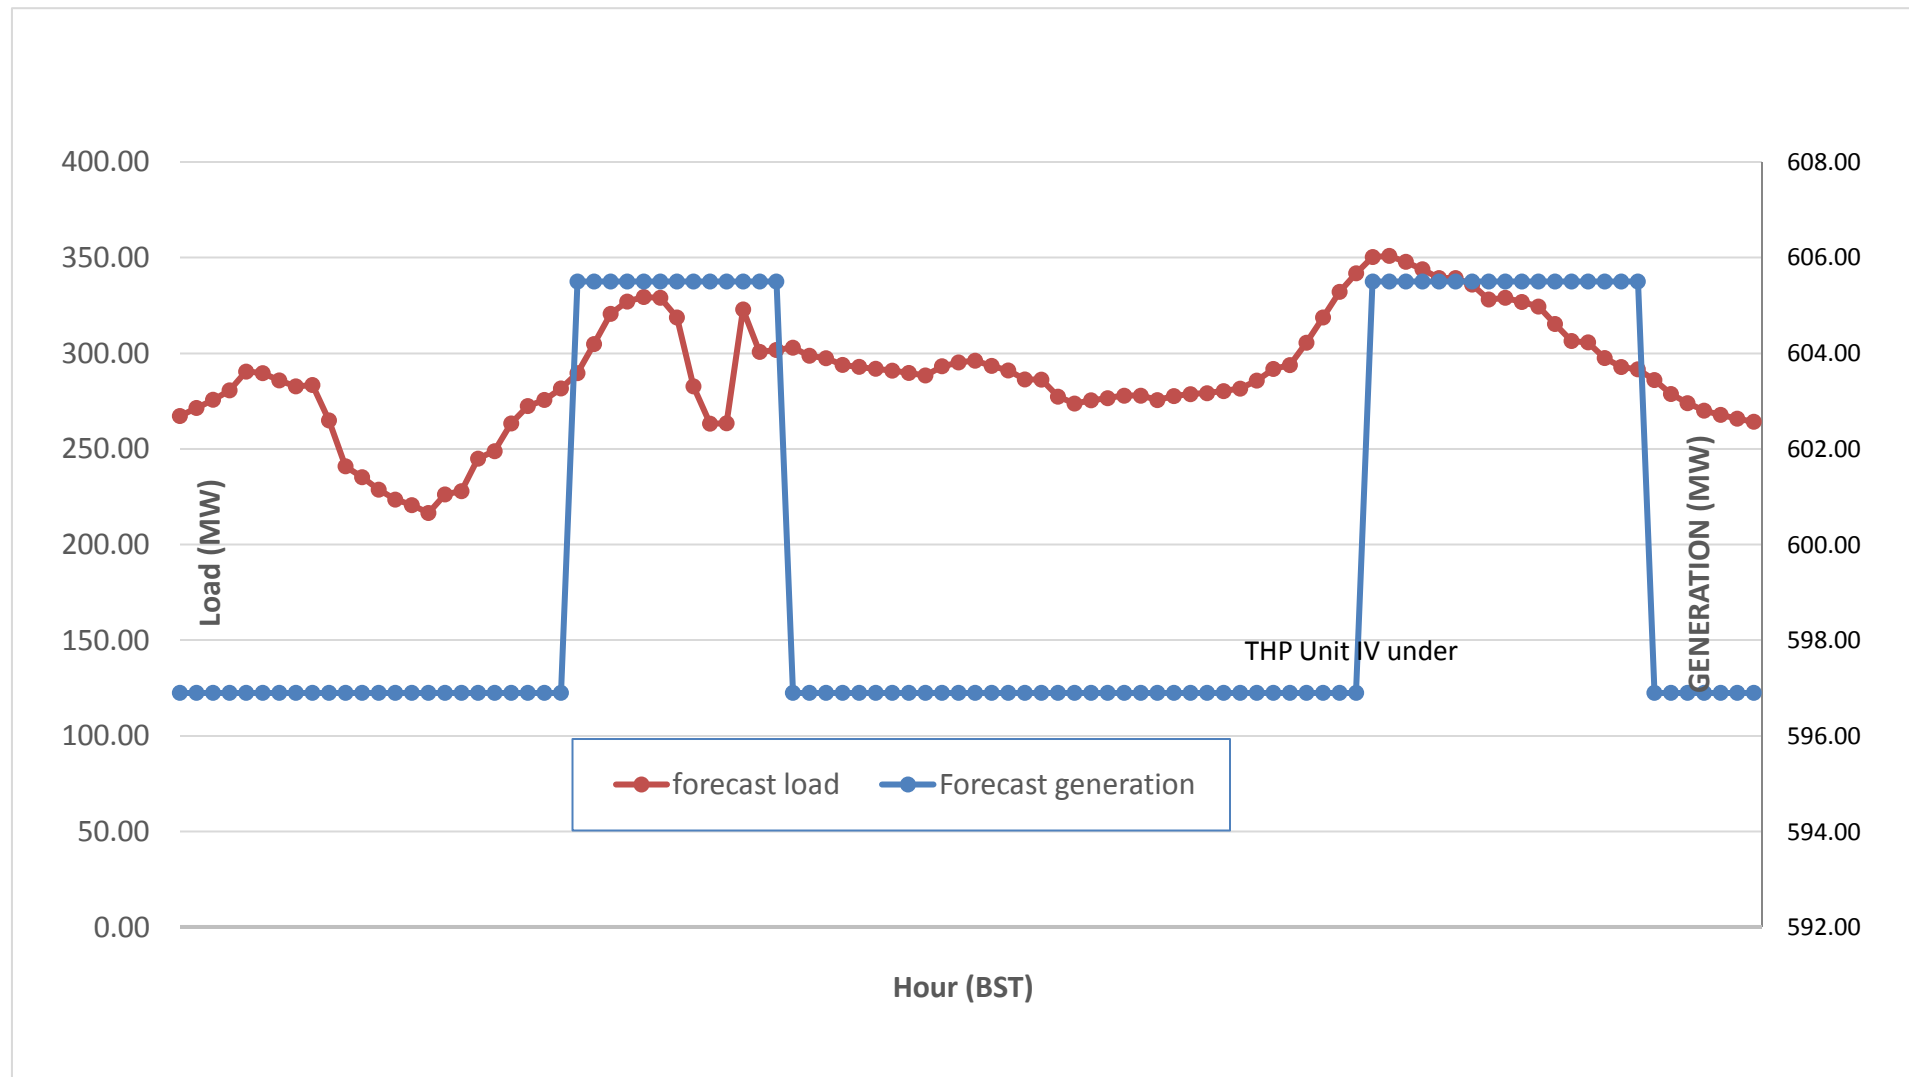

Yours faithfully,
 Manoj Uraon

	MW
Scheduled Peak Generation(18-Nov-2017).	376.90
Forecast Peak Load(18-Nov-2017).	300.60