



འབྲུག་གླིང་མེ་ལམ་འཛིན།

Bhutan Power Corporation Ltd.
Bhutan Power System Operator
Thimphu: Bhutan



Message No.: Enter your message number
From: Shift In-charge, Control Room

Date: 21-Nov-17
Time: 11:21

To
Managing Director, BPC. Email: gemtshering@bpc.bt
Director, O&MD, DGPC. Email: director.omb@drukgreen.com
General Manager, TD, BPC. Email: ktobgye@bpc.bt
General Manager, DCSD, BPC. Email: sandeeprai@bpc.bt
General Manager, BPSO, BPC. Email: ujjwaldahal@bpc.bt

Sub: **Load Generation Balance Report of Yesterday (20-Nov-2017).**

Hours (BST)	Forecast		Actual		Hours (BST)	Forecast		Actual	
	Generation	Load	Generation	Load		Generation	Load	Generation	Load
0:00	561.7	264.9	572.2	257.6	12:00	561.7	292.4	552.22	295.10
0:15	561.7	267.8	571.8	259.3	12:15	561.7	292.4	552.02	298.89
0:30	561.7	269.3	572.0	257.5	12:30	561.7	289.6	551.34	292.83
0:45	561.7	271.2	573.6	248.7	12:45	561.7	284.6	551.00	288.89
1:00	561.7	275.2	571.6	258.8	13:00	561.7	283	553.66	283.38
1:15	561.7	275.9	571.6	252.0	13:15	561.7	276	549.52	280.05
1:30	561.7	277.1	569.6	252.5	13:30	561.7	270.7	552.34	282.09
1:45	561.7	280.6	572.7	253.0	13:45	561.7	272.5	552.66	283.16
2:00	561.7	279.4	572.8	256.2	14:00	561.7	271.5	548.72	282.36
2:15	561.7	273.1	549.7	259.0	14:15	561.7	274.9	542.19	281.37
2:30	561.7	274.9	549.0	259.4	14:30	561.7	274.8	541.47	271.55
2:45	561.7	265.6	551.6	241.9	14:45	561.7	273.3	550.58	280.44
3:00	561.7	252.2	551.2	252.5	15:00	561.7	276.3	552.30	280.95
3:15	561.7	237.7	552.8	250.7	15:15	561.7	276.2	542.28	278.05
3:30	561.7	230.4	551.0	251.5	15:30	561.7	275.8	552.83	285.58
3:45	561.7	222.4	552.2	256.9	15:45	561.7	275.8	559.39	288.91
4:00	561.7	222.1	552.2	256.5	16:00	561.7	275.2	560.39	288.72
4:15	561.7	218.8	547.7	256.4	16:15	561.7	282	562.30	291.14
4:30	561.7	225.3	551.4	262.2	16:30	561.7	289	563.70	291.54
4:45	561.7	223	550.0	264.4	16:45	561.7	290.3	561.80	294.79
5:00	561.7	228.4	552.6	257.6	17:00	561.7	302.7	560.25	300.02
5:15	561.7	233.5	551.9	270.7	17:15	561.7	311.2	560.25	299.03
5:30	561.7	240.7	548.3	276.3	17:30	561.7	325	560.25	302.24
6:45	561.7	258.6	551.7	278.6	17:45	569.8	337.2	566.23	332.54
6:00	561.7	266.3	551.5	279.2	18:00	569.8	347.7	566.84	330.23
6:15	561.7	282.5	554.4	293.7	18:15	569.8	348.2	552.08	337.46
6:30	561.7	298.5	553.2	305.1	18:30	569.8	344.6	564.77	340.85
6:45	561.7	302.3	554.7	309.3	18:45	569.8	342.4	560.84	324.81
7:00	561.7	304	553.9	325.8	19:00	569.8	338.1	565.86	330.12
7:15	561.7	283.4	555.0	324.1	19:15	569.8	335.2	560.81	326.12
7:30	561.7	277.3	553.3	320.6	19:30	569.8	334.9	545.66	319.94
7:45	569.8	260	552.6	318.4	19:45	569.8	327.7	544.84	299.55
8:00	569.8	265.1	555.4	312.1	20:00	569.8	326.7	546.42	298.46
8:15	569.8	282.3	553.5	309.0	20:15	569.8	326.3	546.50	295.81
8:30	569.8	330.9	553.4	301.8	20:30	569.8	323.5	544.48	300.41
8:45	569.8	302.3	552.9	291.1	20:45	569.8	316.3	547.25	296.74
9:00	569.8	301.4	554.2	289.1	21:00	569.8	308.3	545.03	300.52
9:15	569.8	299.4	555.14	292.96	21:15	569.8	308	544.44	295.95
9:30	569.8	296.4	554.41	295.13	21:30	561.7	301.2	545.55	289.58
9:45	561.7	292.6	552.28	294.45	21:45	561.7	295.5	547.39	282.83
10:00	561.7	289.1	550.72	295.13	22:00	561.7	292.3	549.11	273.66
10:15	575.4	287	552.64	292.47	22:15	561.7	284.3	547.34	274.29
10:30	575.4	289	547.17	299.79	22:30	561.7	280	539.66	270.88
10:45	575.4	286.2	536.19	298.19	22:45	561.7	276	546.98	263.70
11:00	575.4	284.1	537.92	299.39	23:00	561.7	273	549.67	263.34
11:15	575.4	283	552.00	298.23	23:15	561.7	268.2	549.05	262.60
11:30	561.7	291.1	553.66	300.33	23:30	561.7	267.3	545.41	260.22
11:45	561.7	291	549.77	297.48	23:45	561.7	266.3	547.20	251.00

Yours faithfully
jangchuk Selden

Coincidental peak load of Day(Last year):	
301.98	20-Nov-16
Maximum Load till date:	
362.09	14-Nov-17



འབྲུག་རྒྱལ་ཁོ་ལས་འཛིན།


Bhutan Power Corporation Ltd.
 Bhutan Power System Operator
 Thimphu: Bhutan



Message No.: Enter your message number
 From: Shift In-charge, Control Room

Date: 21-Nov-17
 Time: 11:21

Forecast Generation & Load with Actual Generation & Load (20-Nov-2017).

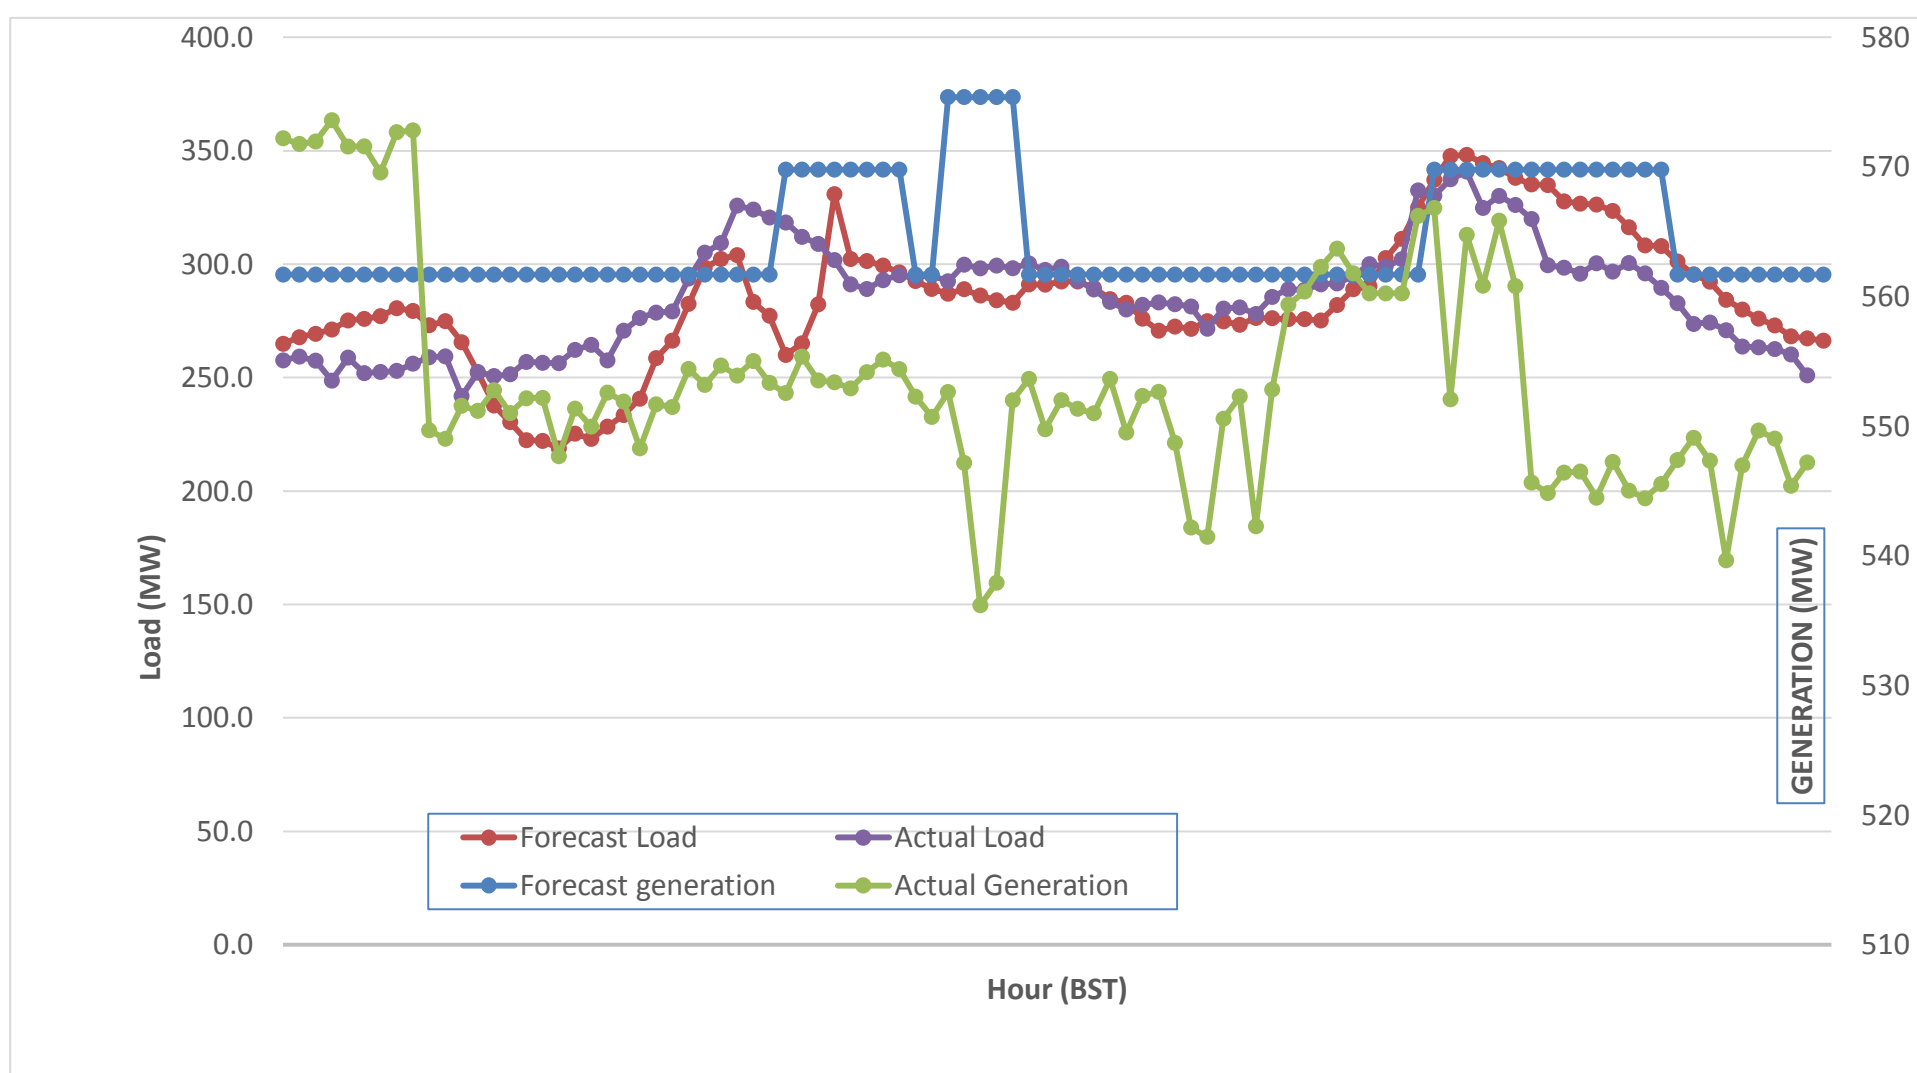

Yours faithfully,
 Jangchuk Selden

	MW	Coincidental peak load of Day(Last year):	
Peak Co-incident Generation(20-Nov-2017).	573.61	301.98	20-Nov-16
Peak Co-incident Load(20-Nov-2017).	340.85		
		Maximum Load till date:	
		362.09	14-Nov-17

Telephone: +975-02335631; Fax: +975-02335632; Email: bhutansystemoperator@bpc.bt; www.bpc.bt



Bhutan Power Corporation Ltd.
Bhutan Power System Operator
Thimphu: Bhutan

ལྷན་དུ་བྱོལ་མེ་ལས་འཛིན།



Message No.: Enter your message number
From: Shift In-charge, Control Room

Date: 21-Nov-17
Time: 11:21

To
 Managing Director, BPC. Email: gemtshering@bpc.bt
 Director, O&MD, DGPC. Email: director.omb@drukgreen.com
 General Manager, TD, BPC. Email: thinleygyeltshen@bpc.bt
 General Manager, DCSD, BPC. Email: sandeprai@bpc.bt
 General Manager, BPSO, BPC. Email: ujjwaldahal@bpc.bt

Sub: Load Generation Balance Report of Today (21-Nov-2017).

Hours (BST)	Forecast		Actual	
	Generation	Load	Generation	Load
0:00	580.8	261.2	546.3	256.2
0:15	580.8	262.3	545.5	252.9
0:30	580.8	264.6	545.5	255.3
0:45	574.3	267.9	546.3	256.8
1:00	574.3	270.8	547.2	254.4
1:15	574.3	272.1	545.5	257.6
1:30	574.3	274.1	544.0	255.0
1:45	574.3	276.7	544.4	255.0
2:00	574.3	274.3	544.4	254.6
2:15	574.3	268.9	547.0	255.6
2:30	574.3	271.6	546.2	252.1
2:45	574.3	269.8	547.7	248.6
3:00	574.3	255.8	547.2	250.9
3:15	574.3	241.5	546.8	248.1
3:30	574.3	235.3	545.9	252.2
3:45	574.3	227.8	547.8	243.3
4:00	574.3	229.2	545.7	239.5
4:15	574.3	226.9	547.9	247.7
4:30	574.3	232.7	548.0	253.8
4:45	574.3	230.2	547.2	258.4
5:00	583.6	232	545.5	251.2
5:15	583.6	236.6	545.8	258.5
5:30	583.6	243.7	544.6	266.8
5:45	583.6	260.6	545.3	271.0
6:00	574.3	267.5	548.4	280.1
6:15	574.3	281	542.5	289.0
6:30	574.3	297.8	545.5	300.8
6:45	574.3	301.4	545.5	310.9
7:00	574.3	303	545.0	316.3
7:15	574.3	288.2	547.6	320.4
7:30	574.3	282.4	560.3	319.6
7:45	574.3	269.1	562.2	316.6
8:00	584.3	267.3	562.7	306.3
8:15	584.3	279.9	558.7	309.6
8:30	584.3	337	563.0	304.1
8:45	584.3	299.9	561.5	304.8
9:00	574.3	299.8	560.6	304.3

Coincidental peak load of Day(Last year):	
280.6	21-Nov-17

Maximum Load till date:	
362.09	14-Nov-17

Yours faithfully,
 Jangchuk Selden


Telephone:



Message No.: Enter your message number
 From: Shift In-charge, Control Room

Date: 21-Nov-17
 Time: 15:28

Forecast Generation & Load with Actual Generation & Load of Today from 00:00hrs to 09:00hrs(21-Nov-2017).

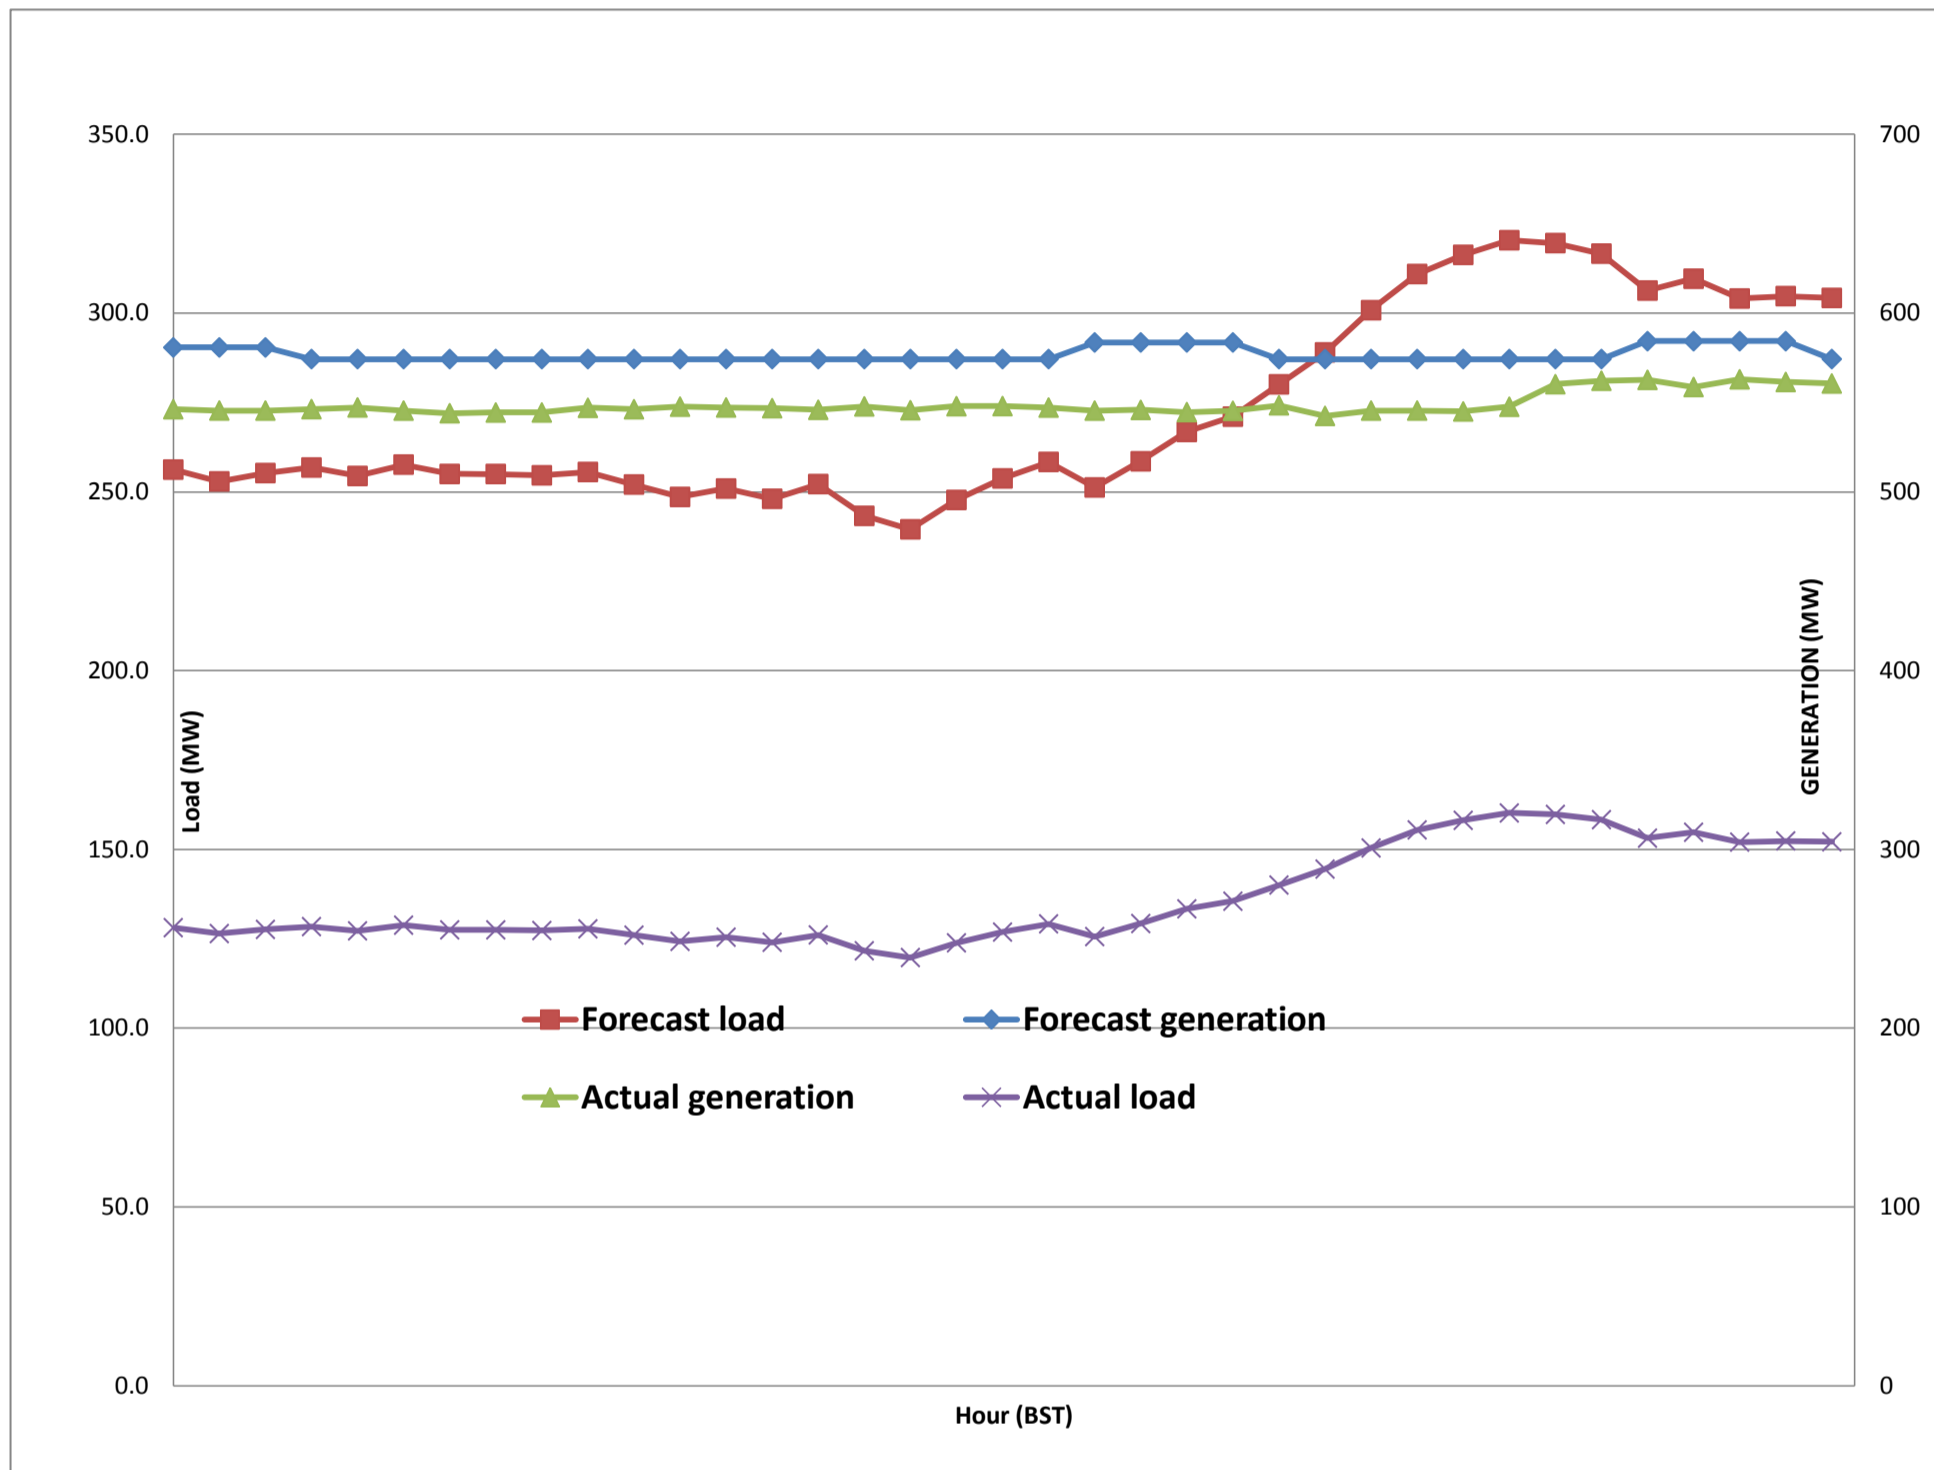

Yours faithfully
 jangchuk Selden



འབྲུག་གྲོག་ལས་ཁུངས་ལྷན་ཁག།
Bhutan Power Corporation Ltd.
Bhutan Power System Operator
 Thimphu: Bhutan



Message No.: Enter your message number
From: Shift In-charge, Control Room
Date: 21-Nov-17
Time: 15:28

To

Managing Director, BPC. Email: gemtshering@bpc.bt
 Director, O&MD, DGPC. Email: director.umd@drukgreen.com
 General Manager, TD, BPC. Email: ktobgye@bpc.bt
 General Manager, BPSO, BPC. Email: ujjwaldahal@bpc.bt
 Advisor, BPC. Email: bharattamang@bpc.bt

Sub: Load Generation Balance Report of Tomorrow (22-Nov-2017).

Hours (BST)	Forecast		Hours (BST)	Forecast	
	Generation	Load		Generation	Load
0:00	552	260.7	4:48	552	294.1
0:15	552	261.9	2:24	552	293.7
0:30	552	263	0:00	552	292.2
0:45	552	264.1	7:12	552	285.6
1:00	552	269.3	16:48	552	285.3
1:15	552	268.8	0:00	552	279.5
1:30	552	272	2:24	552	272.5
1:45	552	273.3	4:48	552	277
2:00	552	278.1	4:48	552	277.2
2:15	552	275.3	19:12	552	279.8
2:30	552	278.7	21:36	552	275.7
2:45	552	256.6	4:48	552	276.1
3:00	552	247.7	16:48	552	278.2
3:15	552	232.9	2:24	552	278.1
3:30	552	232.8	14:24	552	279.2
3:45	552	226.3	9:36	552	280.2
4:00	552	224.4	7:12	552	280.6
4:15	552	225.6	19:12	552	284.5
4:30	552	233.4	12:00	552	290.9
4:45	552	235.1	16:48	552	293.3
5:00	552	241.9	7:12	552	302.3
5:15	552	253.5	9:36	552	310.6
5:30	552	269	4:48	552	321.4
6:45	552	278.8	9:36	559.5	334.8
6:00	552	284.5	4:48	559.5	344.5
6:15	552	294.7	21:36	559.5	345.5
6:30	552	306.4	14:24	559.5	342.1
6:45	552	310.1	7:12	559.5	339.8
7:00	552	322.2	21:36	559.5	335.4
7:15	552	316.9	7:12	559.5	332.3
7:30	552	314.9	19:12	559.5	330.2
7:45	559.5	288.8	21:36	559.5	321.4
8:00	559.5	269	16:48	559.5	319.6
8:15	559.5	260.6	21:36	559.5	318.7
8:30	559.5	329.7	0:00	559.5	319.5
8:45	559.5	298.9	9:36	565.8	313.6
9:00	559.5	299.1	19:12	565.8	308
9:15	559.5	298.9	2:24	565.8	305.1
9:30	559.5	295.3	12:00	558.2	298.6
9:45	552	293.4	16:48	558.2	292.5
10:00	552	290.5	16:48	558.2	289
10:15	552	289.9	0:00	558.2	282.8
10:30	552	292.2	7:12	558.2	278
10:45	552	289.6	2:24	558.2	272.9
11:00	552	288.1	16:48	558.2	270.6
11:15	552	287.2	9:36	558.2	266.8
11:30	552	292.5	14:24	552	265.5
11:45	552	293.2	4:48	552	263


Yours faithfully,
 Jangchuk Selden



Message No.: Enter your message number
 From: Shift In-charge, Control Room

Date: 21-Nov-17
 Time: 11:21

Scheduled Generation & Load Forecast for Tomorrow (22-Nov-2017).

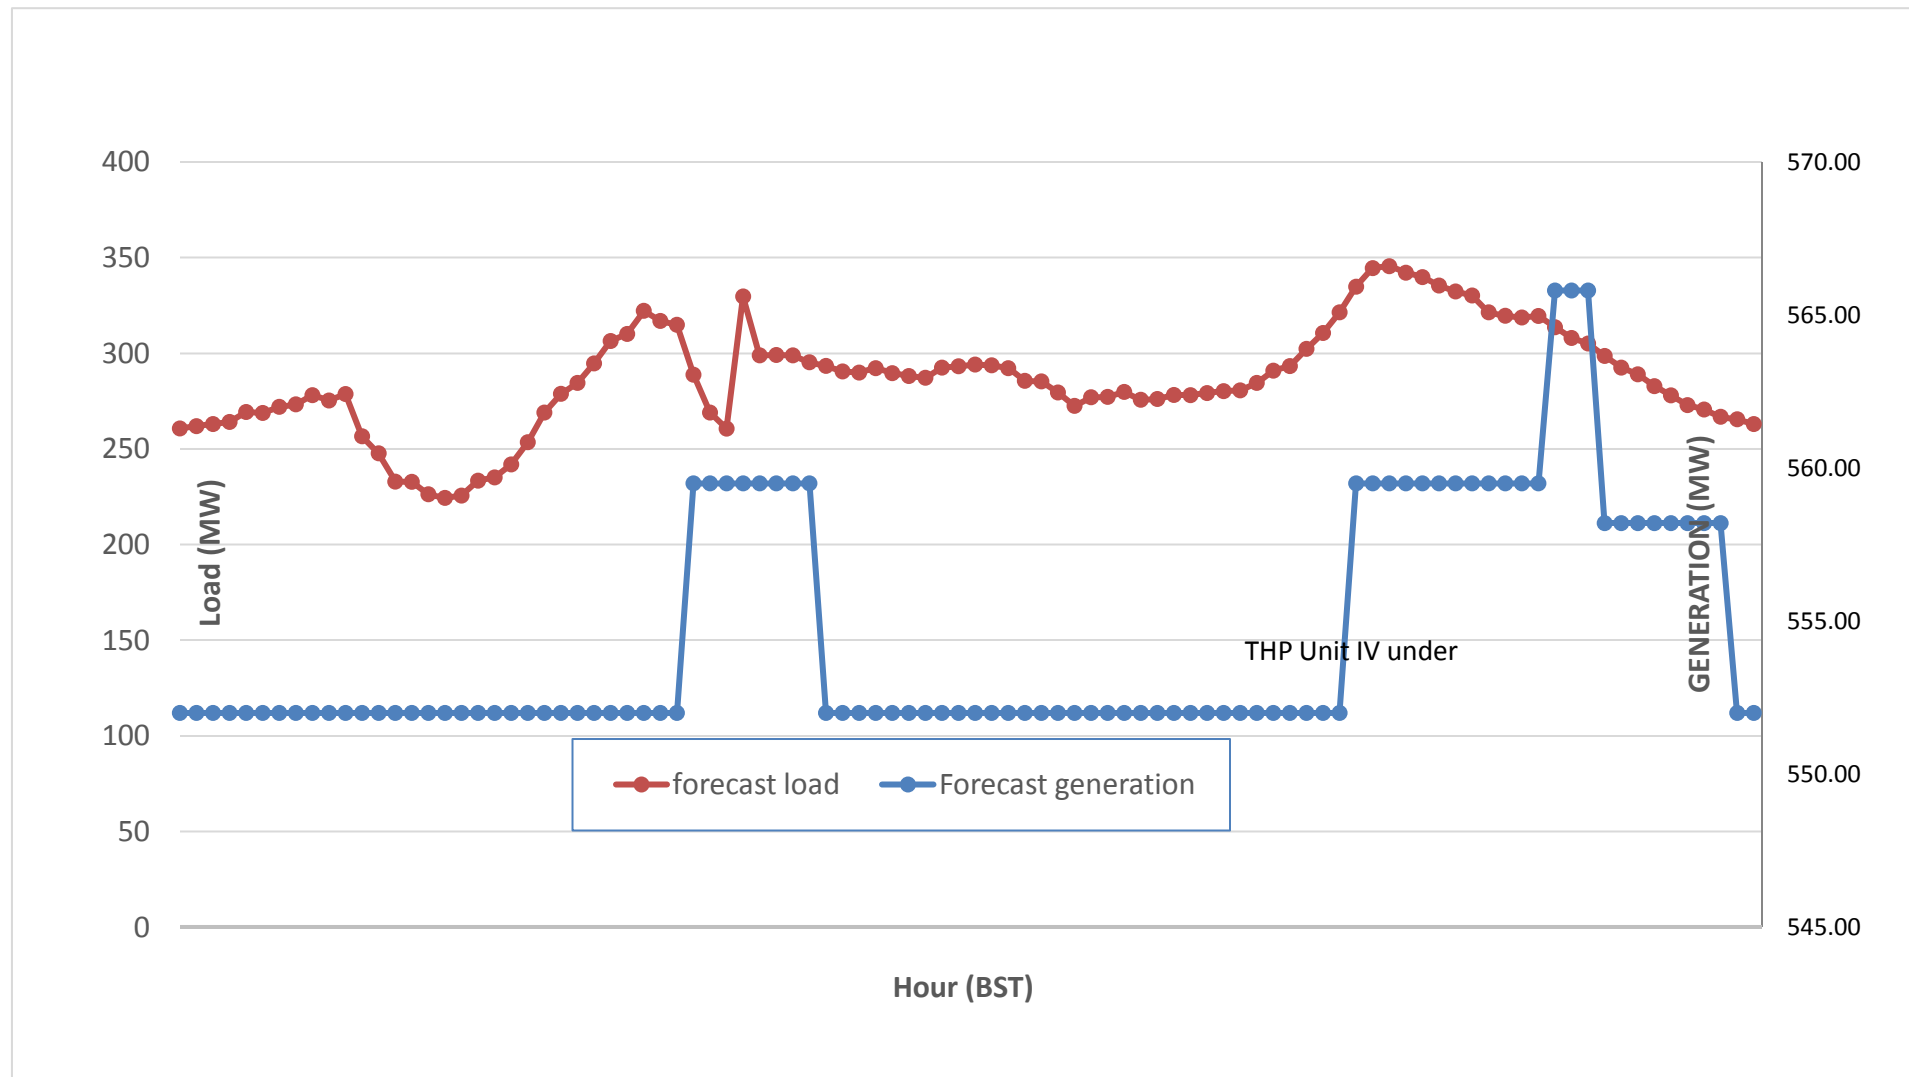

Yours faithfully,
 jangchuk Selden

	MW
Scheduled Peak Generation(22-Nov-2017).	376.90
Forecast Peak Load(22-Nov-2017).	300.60