



ལྷན་ རྒྱལ་གྱི་མེ་ལས་འཛིན།

Bhutan Power Corporation Ltd.
Bhutan Power System Operator
Thimphu: Bhutan



Message No.: Enter your message number
From: Shift In-charge, Control Room

Date: 27-Nov-17
Time: 11:32

To
Managing Director, BPC. Email: gemtshering@bpc.bt
Director, O&MD, DGPC. Email: director.omb@drukgreen.com
General Manager, TD, BPC. Email: ktobgye@bpc.bt
General Manager, DCSD, BPC. Email: sandeeprai@bpc.bt
General Manager, BPSO, BPC. Email: ujjwaldahal@bpc.bt

Sub: **Load Generation Balance Report of Yesterday (26-Nov-2017).**

Hours (BST)	Forecast		Actual		Hours (BST)	Forecast		Actual	
	Generation	Load	Generation	Load		Generation	Load	Generation	Load
0:00	515.1	256	528.6	263.4	12:00	514	285.1	526.50	246.93
0:15	515.1	256.3	526.1	262.6	12:15	514	285.6	526.50	246.93
0:30	515.1	253.9	526.5	266.7	12:30	514	286.6	526.50	246.93
0:45	515.1	257.4	529.5	260.4	12:45	514	282.3	526.50	246.93
1:00	515.1	260	526.1	252.2	13:00	514	278.8	526.50	246.93
1:15	515.1	259.5	528.5	257.1	13:15	514	276.6	526.50	246.93
1:30	515.1	262.3	527.9	260.7	13:30	514	273.4	526.50	246.93
1:45	515.1	259.9	525.8	259.4	13:45	514	272.1	526.50	246.93
2:00	515.1	264.2	526.6	261.1	14:00	514	269.2	515.53	285.46
2:15	515.1	263.5	527.7	259.1	14:15	514	271.7	517.09	284.96
2:30	515.1	264.6	525.9	251.0	14:30	514	271.3	517.28	287.44
2:45	515.1	264.6	526.5	246.9	14:45	514	269.4	517.53	288.66
3:00	515.1	266.6	526.5	246.9	15:00	514	269.5	517.48	292.06
3:15	515.1	269	526.5	246.9	15:15	514	270.2	518.34	297.10
3:30	515.1	269.5	526.5	246.9	15:30	514	272	518.67	297.88
3:45	515.1	265.9	526.5	246.9	15:45	514	276.4	515.36	306.48
4:00	515.1	262.6	526.5	246.9	16:00	514	275.8	517.27	322.82
4:15	515.1	261.8	526.5	246.9	16:15	514	279.6	517.97	324.39
4:30	515.1	266.6	526.5	246.9	16:30	514	286.4	517.77	333.68
4:45	515.1	265.7	526.5	246.9	16:45	514	288.1	517.80	335.02
5:00	515.1	260.8	526.5	246.9	17:00	514	298.2	518.64	331.07
5:15	515.1	260.2	526.5	246.9	17:15	515.1	305.4	517.84	338.38
5:30	515.1	237.9	526.5	246.9	17:30	515.1	320.8	516.66	328.17
6:45	515.1	227.7	526.5	246.9	17:45	515.1	332.5	517.97	330.05
6:00	515.1	229.5	526.5	246.9	18:00	515.1	338.8	518.39	332.15
6:15	515.1	237.5	526.5	246.9	18:15	515.1	341.9	517.83	323.92
6:30	515.1	245.5	526.5	246.9	18:30	515.1	338.4	520.78	328.02
6:45	515.1	251	526.5	246.9	18:45	515.1	337	517.86	325.86
7:00	515.1	258.6	526.5	246.9	19:00	515.1	334.2	514.23	312.30
7:15	515.1	265.1	526.5	246.9	19:15	515.1	331.1	519.89	320.98
7:30	515.1	272.7	526.5	246.9	19:30	515.1	328	514.81	316.10
7:45	515.1	301.1	526.5	246.9	19:45	515.1	322.8	517.36	314.35
8:00	515.1	313.4	526.5	246.9	20:00	515.1	323.1	517.28	311.23
8:15	515.1	320.6	526.5	246.9	20:15	515.1	321.6	518.58	303.55
8:30	515.1	312.2	526.5	246.9	20:30	515.1	317.7	519.67	291.92
8:45	515.1	298.3	526.5	246.9	20:45	515.1	314.1	518.58	286.40
9:00	514	298.5	526.5	246.9	21:00	515.1	308.9	518.17	282.64
9:15	514	300.1	526.50	246.93	21:15	515.1	305	519.86	279.02
9:30	514	295.2	526.50	246.93	21:30	515.1	293.7	518.14	282.04
9:45	514	290.7	526.50	246.93	21:45	515.1	288.3	517.28	280.56
10:00	514	289.2	526.50	246.93	22:00	515.1	281.9	518.94	274.01
10:15	514	286.4	526.50	246.93	22:15	515.1	276.8	516.64	272.64
10:30	514	289.7	526.50	246.93	22:30	515.1	272.1		
10:45	514	285.4	526.50	246.93	22:45	513.5	267.5		
11:00	514	289	526.50	246.93	23:00	513.5	265.5		
11:15	514	286.4	526.50	246.93	23:15	513.5	264.2		
11:30	514	285.9	526.50	246.93	23:30	513.5	262.6		
11:45	514	284.4	526.50	246.93	23:45	513.5	258		

Yours faithfully
Kinley Wangmo

Coincidental peak load of Day(Last year):	
285.73	26-Nov-16
Maximum Load till date:	
362.09	14-Nov-17



འབྲུག་རྒྱལ་ཁོ་ལས་འཛིན།


Bhutan Power Corporation Ltd.
 Bhutan Power System Operator
 Thimphu: Bhutan



Message No.: Enter your message number
 From: Shift In-charge, Control Room

Date: 27-Nov-17
 Time: 11:32

Forecast Generation & Load with Actual Generation & Load (26-Nov-2017).

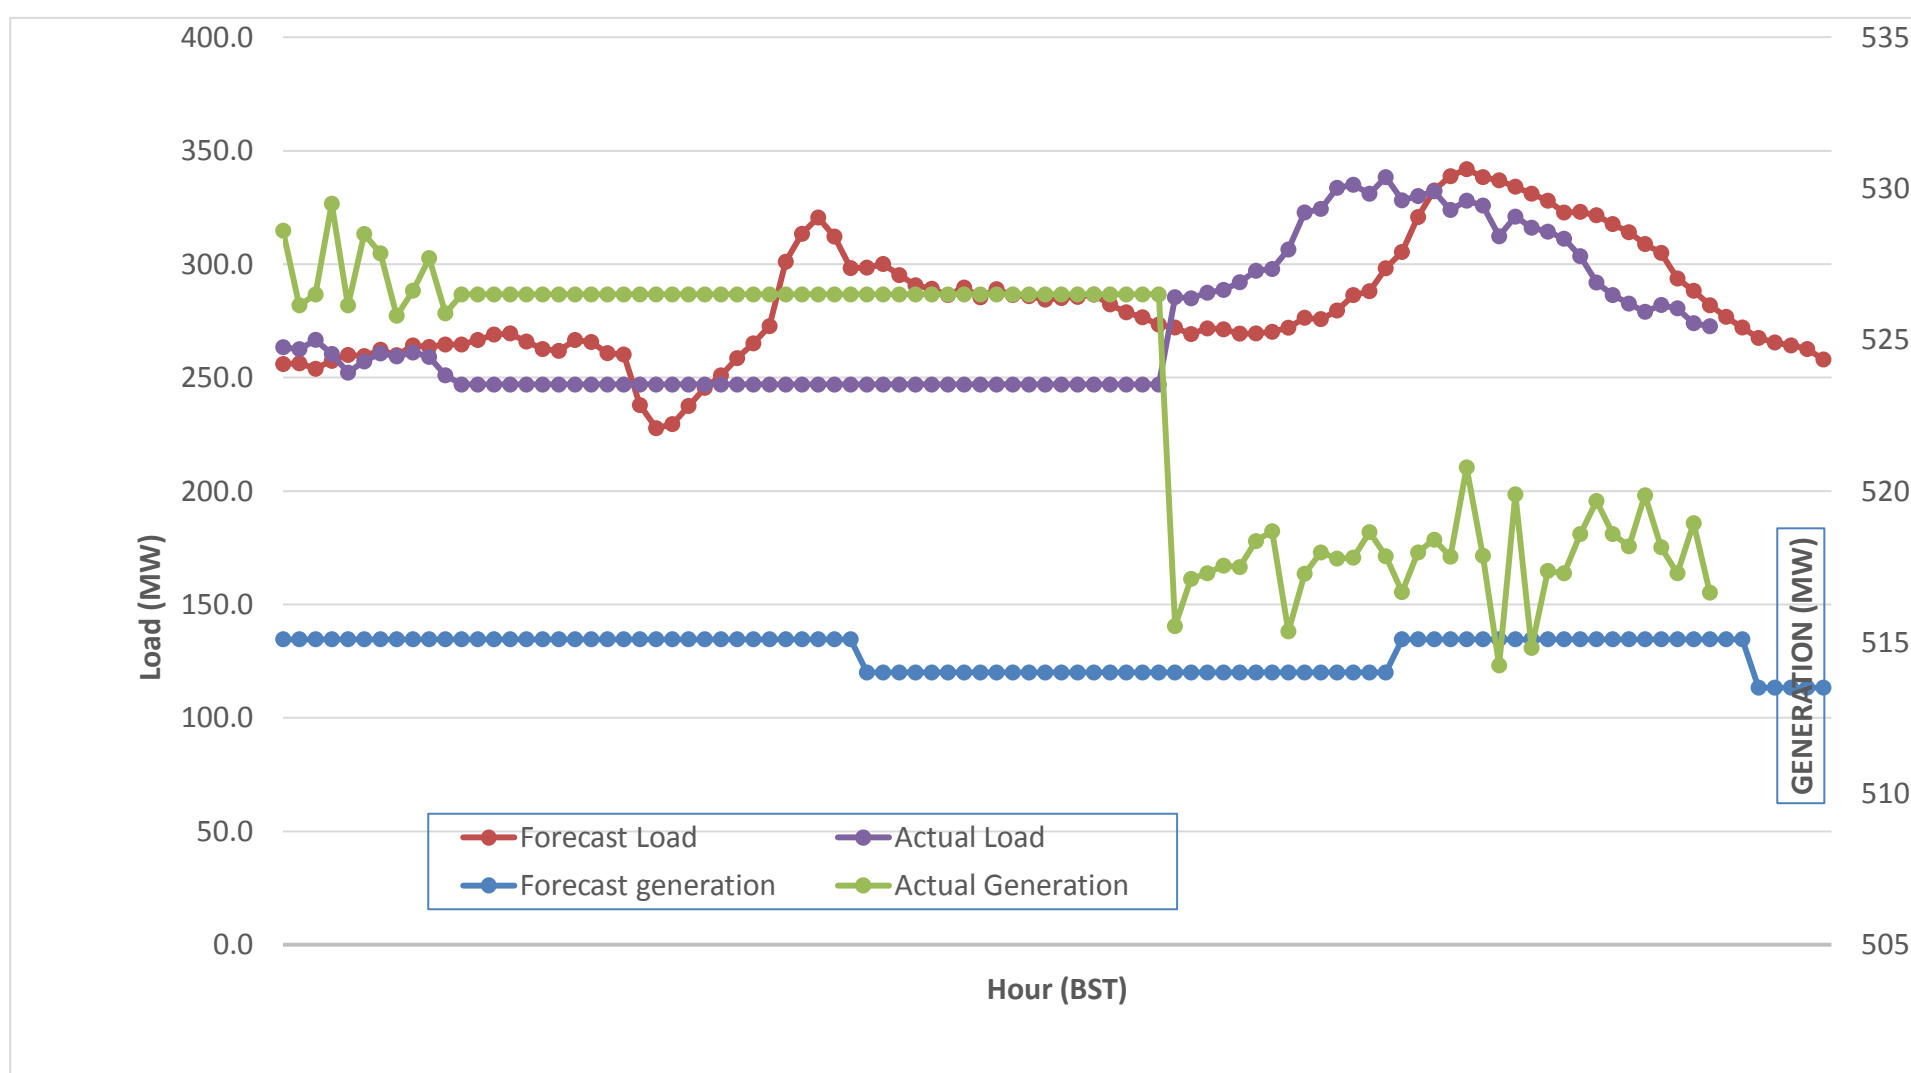

Yours faithfully,
 Kinley Wangmo

	MW	Coincidental peak load of Day(Last year):	
Peak Co-incident Generation(26-Nov-2017).	529.50	285.73	26-Nov-16
Peak Co-incident Load(26-Nov-2017).	338.38		
		Maximum Load till date:	
		362.09	14-Nov-17

Telephone: +975-02335631; Fax: +975-02335632; Email: bhutansystemoperator@bpc.bt; www.bpc.bt



Bhutan Power Corporation Ltd.
Bhutan Power System Operator
Thimphu: Bhutan

ལྷན་ཁག་གི་འགན་ཁུར་པོ་ལྷན་པོ།



Message No.: Enter your message number
From: Shift In-charge, Control Room

Date: 27-Nov-17
Time: 11:32

To
 Managing Director, BPC. Email: gemtshering@bpc.bt
 Director, O&MD, DGPC. Email: director.omid@drukgreen.com
 General Manager, TD, BPC. Email: thinleygyeltshen@bpc.bt
 General Manager, DCSD, BPC. Email: sandeprai@bpc.bt
 General Manager, BPSO, BPC. Email: ujjwaldahal@bpc.bt

Sub: Load Generation Balance Report of Today (27-Nov-2017).

Hours (BST)	Forecast		Actual	
	Generation	Load	Generation	Load
0:00	445.8	255.5	515.9	267.6
0:15	445.8	254.2	518.1	266.1
0:30	445.8	254.8	514.7	263.6
0:45	520.8	256.9	518.9	262.3
1:00	520.8	260.6	518.0	256.0
1:15	520.8	260.1	518.0	258.0
1:30	520.8	260.7	516.8	257.1
1:45	520.8	256.2	519.0	255.9
2:00	520.8	261.7	517.0	263.6
2:15	520.8	261.6	517.3	263.0
2:30	520.8	263.3	515.6	261.8
2:45	520.8	260	517.8	258.1
3:00	520.8	261.9	509.8	256.7
3:15	520.8	268.4	510.6	256.4
3:30	520.8	269.5	511.1	252.0
3:45	520.8	271.4	508.0	247.4
4:00	520.8	268.9	509.6	237.9
4:15	520.8	266.6	511.7	243.6
4:30	520.8	276.9	507.5	240.2
4:45	520.8	272.2	510.6	245.4
5:00	520.8	268.6	508.8	245.9
5:15	520.8	245.1	509.4	240.6
5:30	520.8	221.1	509.9	248.6
5:45	520.8	216.9	508.0	254.3
6:00	520.8	227	509.7	268.8
6:15	520.8	236.4	510.0	272.5
6:30	520.8	254.7	510.3	270.5
6:45	520.8	261.5	508.6	285.6
7:00	520.8	268.6	510.1	286.1
7:15	520.8	274.1	507.6	279.2
7:30	520.8	277.2	506.1	283.2
7:45	520.8	298	510.5	287.0
8:00	520.8	314.7	521.2	288.5
8:15	520.8	316.3	512.6	290.6
8:30	520.8	312.4	512.9	291.4
8:45	559.5	298.9	544.4	294.8
9:00	559.5	299.1	546.1	299.3

Remarks
 ELDC NLDC link down

Coincidental peak load of Day(Last year):	
285.15	27-Nov-17

Maximum Load till date:	
362.09	14-Nov-17

Yours faithfully,
 Kinley Wangmo


Telephone:



Message No.: Enter your message number
 From: Shift In-charge, Control Room

Date: 27-Nov-17
 Time: 11:32

Forecast Generation & Load with Actual Generation & Load of Today from 00:00hrs to 09:00hrs(27-Nov-2017).

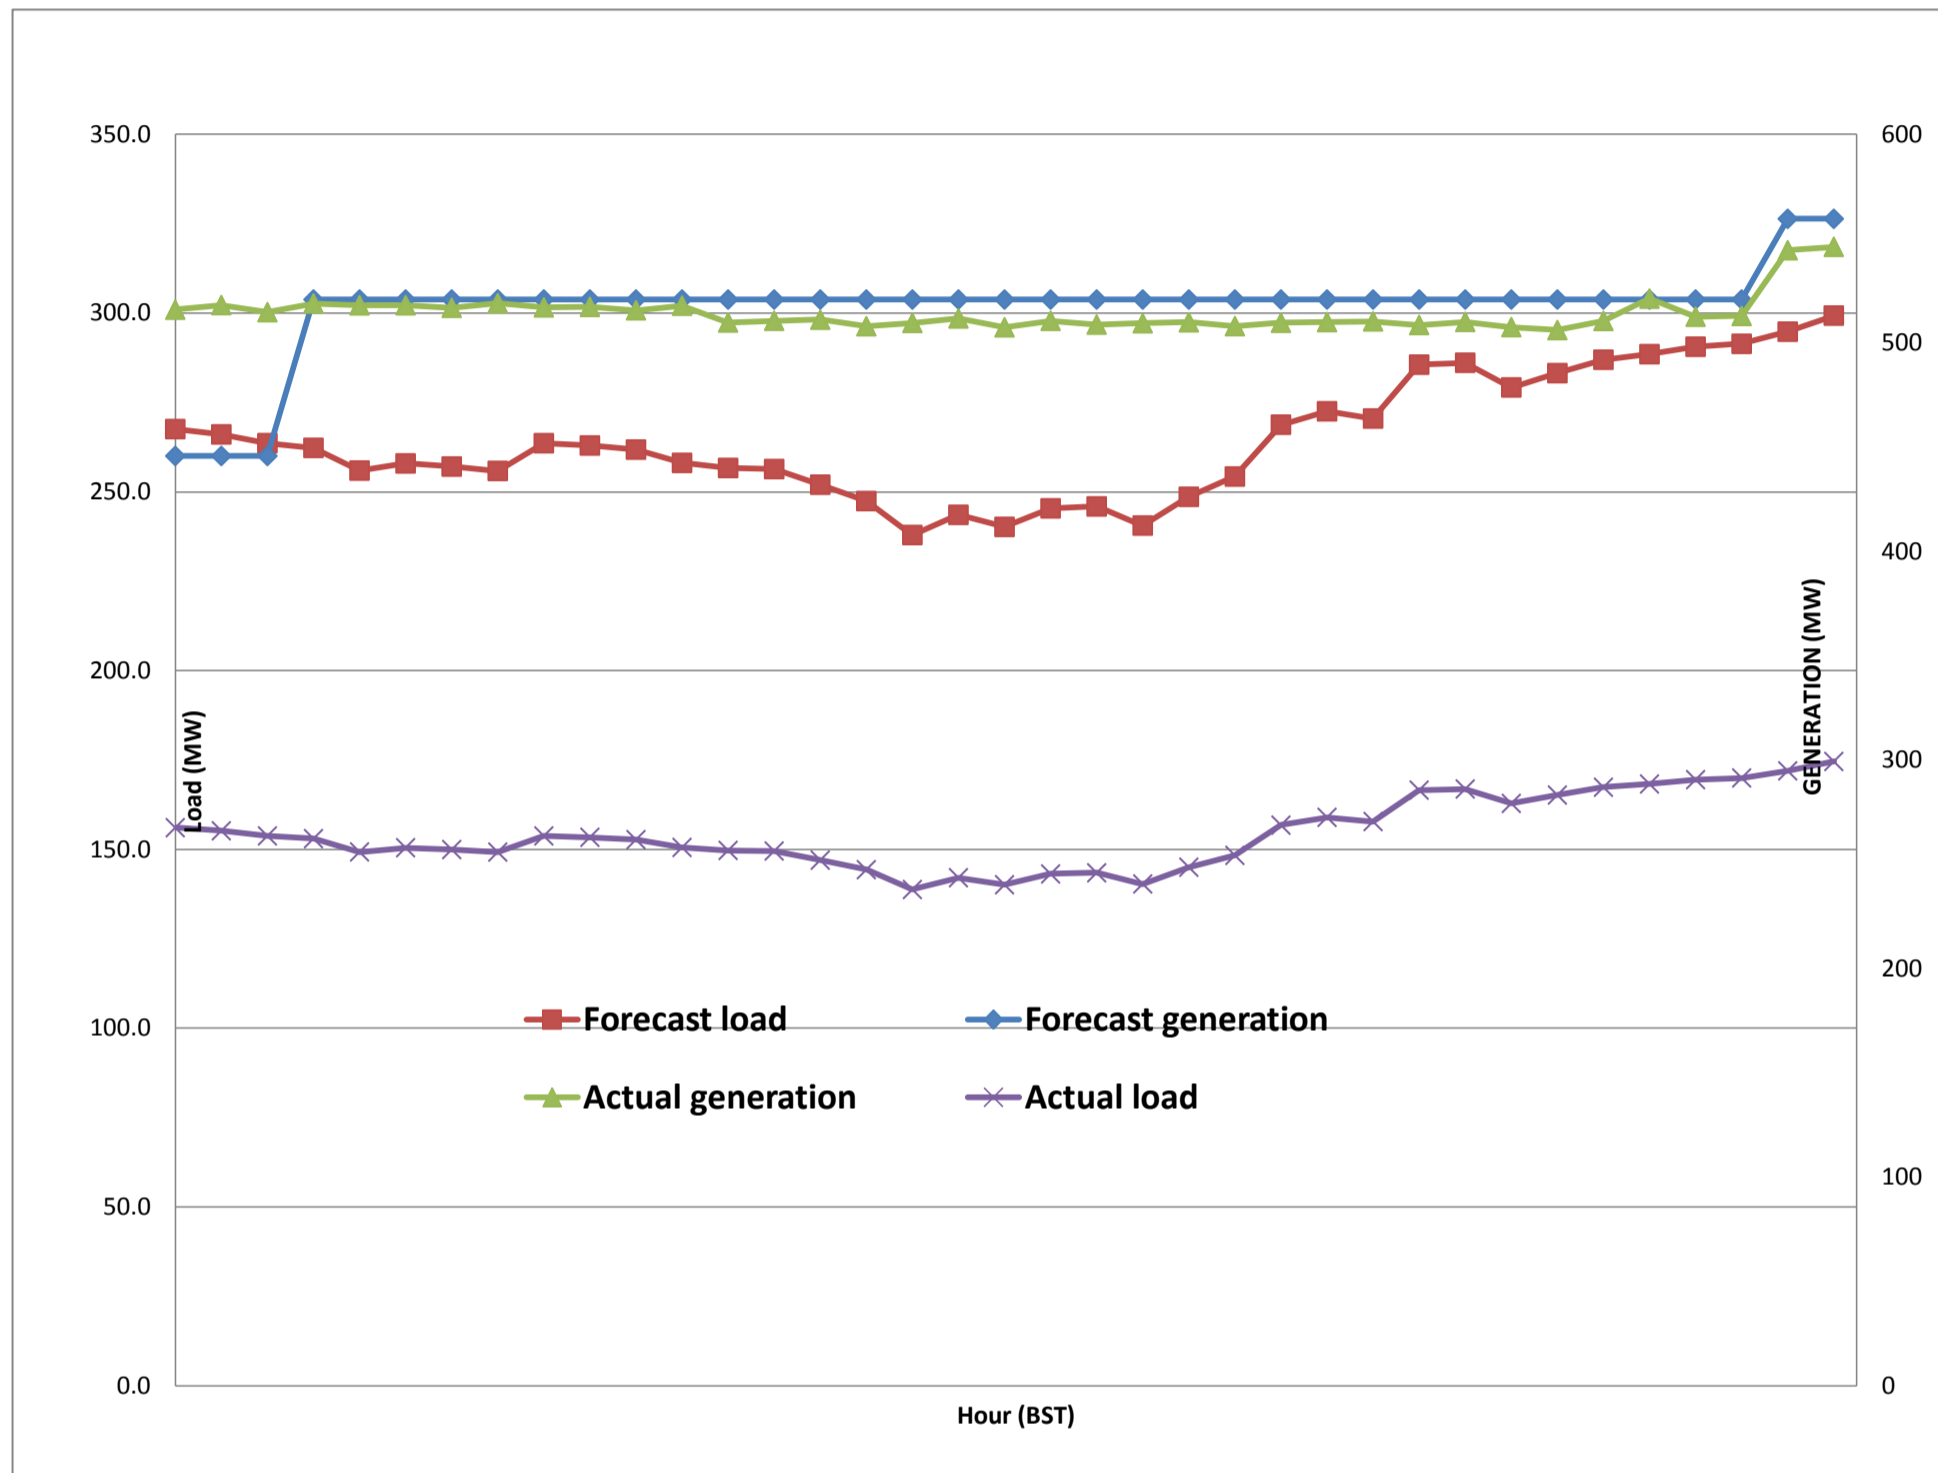



འབྲུག་གྲོགས་ལས་ཁུངས་།
Bhutan Power Corporation Ltd.
Bhutan Power System Operator
 Thimphu: Bhutan




Message No.: Enter your message number **Date:** 27-Nov-17
From: Shift In-charge, Control Room **Time:** 11:32

To
 Managing Director, BPC. Email: gemtshering@bpc.bt
 Director, O&MD, DGPC. Email: director.umd@drukgreen.com
 General Manager, TD, BPC. Email: ktobgye@bpc.bt
 General Manager, BPSO, BPC. Email: ujjwaldahal@bpc.bt
 Advisor, BPC. Email: bharattamang@bpc.bt

Sub: Load Generation Balance Report of Tomorrow (28-Nov-2017).

Hours (BST)	Forecast		Hours (BST)	Forecast	
	Generation	Load		Generation	Load
0:00	531.1	256.8	4:48	531.1	275.9
0:15	531.1	256.4	2:24	531.1	276.1
0:30	531.1	257.2	0:00	531.1	277.2
0:45	531.1	256.5	7:12	531.1	273.8
1:00	531.1	258.2	16:48	531.1	269.7
1:15	531.1	259.2	0:00	531.1	268.1
1:30	531.1	260	2:24	531.1	269.4
1:45	531.1	256.9	4:48	531.1	267.1
2:00	531.1	260.4	4:48	531.1	266.5
2:15	531.1	259.9	19:12	531.1	268.5
2:30	531.1	259.1	21:36	531.1	268.3
2:45	531.1	256	4:48	531.1	267.4
3:00	531.1	257.8	16:48	531.1	277.6
3:15	531.1	262.3	2:24	531.1	279.9
3:30	531.1	263.2	14:24	531.1	281.9
3:45	531.1	264.7	9:36	531.1	285
4:00	531.1	262.5	7:12	531.1	284.7
4:15	531.1	260.7	19:12	531.1	290.5
4:30	531.1	268.5	12:00	531.1	293.2
4:45	531.1	266.2	16:48	531.1	294.6
5:00	531.1	262.8	7:12	531.1	302.6
5:15	531.1	256.2	9:36	531.1	312.2
5:30	531.1	230.1	4:48	531.1	321.4
6:45	531.1	222.8	9:36	531.1	332.1
6:00	531.1	225.6	4:48	531.1	333.4
6:15	531.1	229.6	21:36	531.1	337.3
6:30	531.1	245.6	14:24	531.1	336.3
6:45	531.1	246.5	7:12	531.1	334.4
7:00	531.1	250.9	21:36	531.1	332.6
7:15	531.1	263.8	7:12	531.1	331
7:30	531.1	269.3	19:12	531.1	326.9
7:45	531.1	295.8	21:36	531.1	325
8:00	531.1	297.4	16:48	531.1	325.5
8:15	531.1	297	21:36	531.1	320.1
8:30	531.1	294.3	0:00	531.1	319.2
8:45	531.1	285.5	9:36	531.1	316.5
9:00	531.1	285.8	19:12	531.1	312
9:15	531.1	285.2	2:24	531.1	307
9:30	531.1	280.4	12:00	531.1	299.3
9:45	531.1	275	16:48	531.1	296.1
10:00	531.1	273.5	16:48	531.1	287.9
10:15	531.1	272.8	0:00	531.1	281.2
10:30	531.1	272.3	7:12	531.1	275.7
10:45	531.1	270.7	2:24	531.1	272.1
11:00	531.1	275.9	16:48	531.1	271.5
11:15	531.1	273.9	9:36	407.5	268.6
11:30	531.1	276.4	14:24	407.5	265.1
11:45	531.1	275.7	4:48	407.5	261.8


Yours faithfully,
 Kinley Wangmo



Message No.: Enter your message number
 From: Shift In-charge, Control Room

Date: 27-Nov-17
 Time: 11:32

Scheduled Generation & Load Forecast for Tomorrow (28-Nov-2017).

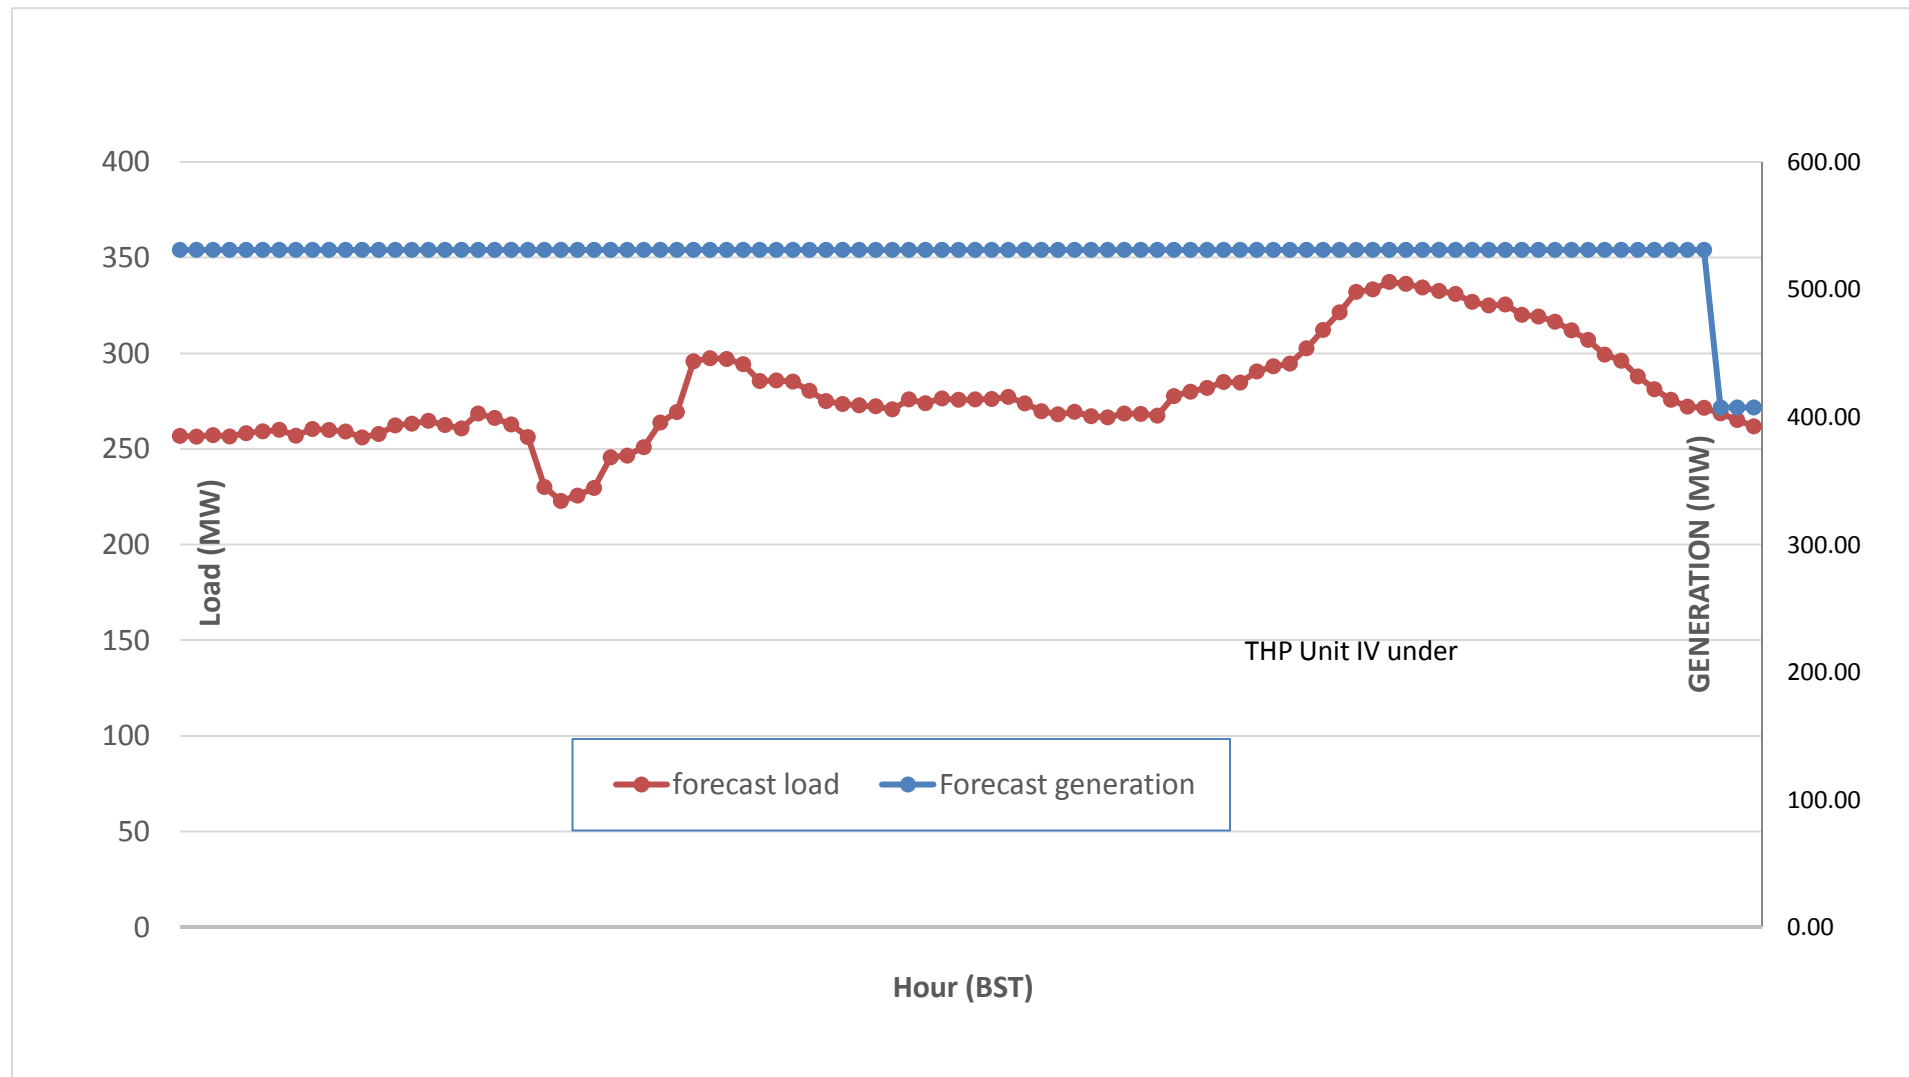

Yours faithfully,
 Kinley Wangmo

	MW
Scheduled Peak Generation(28-Nov-2017).	376.90
Forecast Peak Load(28-Nov-2017).	300.60